

# CITRINE POWER, LLC

## "CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II"

**46 SKINNER STREET  
EAST HAMPTON, CT 06424**

### LIST OF DRAWINGS

- T-1 TITLE SHEET & INDEX
- 1 OF 1 PROPERTY & TOPOGRAPHIC SURVEY PROVIDED BY MARTIN SURVEYING ASSOCIATES
- OP-1 OVERALL LOCUS MAP
- SP-1 SITE & UTILITY PLAN
- SP-2 SITE & UTILITY PLAN
- GP-1 GRADING & DRAINAGE PLAN
- GP-2 GRADING & DRAINAGE PLAN
- EC-1 SEDIMENTATION & EROSION CONTROL PLAN
- EC-2 SEDIMENTATION & EROSION CONTROL PLAN
- EC-3 SEDIMENTATION & EROSION CONTROL NOTES
- EC-4 SEDIMENTATION & EROSION CONTROL DETAILS
- DN-1 SITE DETAILS
- DN-2 SITE DETAILS
- DN-3 SITE NOTES

### SITE INFORMATION

SITE NAME: "CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II"  
 LOCATION: 46 SKINNER STREET  
 EAST HAMPTON, CT 06424

SITE TYPE/DESCRIPTION: ADD (1) GROUND MOUNTED SOLAR PANEL ARRAY W/ ASSOCIATED EQUIPMENT.

PROPERTY OWNER: SKINNER STREET PROPERTIES LLC  
 9 SEQUONIA TRAIL  
 EAST HAMPTON, CT 06424

APPLICANT: CITRINE POWER LLC  
 55 GREENS FARMS ROAD  
 WESTPORT, CT 06880

ENGINEER CONTACT: BRADLEY J. PARSONS, P.E.  
 (860) 663-1697 x208

LATITUDE: 41°34'05.44" N  
 LONGITUDE: 72°30'31.80" W  
 ELEVATION: 425± AMSL

MBLU: 20-48C-9  
 ZONE: I  
 EXISTING LAND USE: INDUSTRIAL  
 COMMUNICATIONS, TRANSPORTATION  
 AND PUBLIC UTILITY USES  
 PROPOSED LAND USE: - LARGE SCALE GROUND MOUNTED SOLAR PHOTOVOLTAIC INSTALLATIONS

TOTAL SITE ACERAGE: 27.42± AC.  
 TOTAL DISTURBED AREA: 14.93± AC.

APPROX. VOLUME OF CUT: 2,919± CY  
 APPROX. VOLUME OF FILL: 1,445± CY  
 APPROX. NET VOLUME: 1,474± CY OF CUT

### USGS TOPOGRAPHIC MAP



SCALE: 1" = 2000'± SOURCE: USGS 7.5 MIDDLE HADDAM QUADRANGLE, CT 2018



55 GREENS FARMS ROAD  
 WESTPORT, CT 06880  
 OFFICE: (203)-557-5554



3 SADDLEBROOK DRIVE PHONE: (860)-663-1697  
 KILLINGWORTH, CT 06419 FAX: (860)-663-0935  
 WWW.ALLPOINTS TECH.COM

#### CSC PERMIT SET

NO	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

#### DESIGN PROFESSIONAL OF RECORD

PROF: BRADLEY J. PARSONS P.E.  
 COMP: ALL-POINTS TECHNOLOGY CORPORATION  
 ADD: 3 SADDLEBROOK DRIVE  
 KILLINGWORTH, CT 06419

OWNER: SKINNER STREET PROPERTIES LLC  
 ADDRESS: 9 SEQUONIA TRAIL  
 EAST HAMPTON, CT 06424

#### CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II

SITE ADDRESS: EAST HAMPTON, CT 06424


APT FILING NUMBER: CT567110

DATE: 02/14/20 DRAWN BY: CSH  
 CHECKED BY: BJP

SHEET TITLE:  
**TITLE SHEET & INDEX**

SHEET NUMBER:

**T-1**

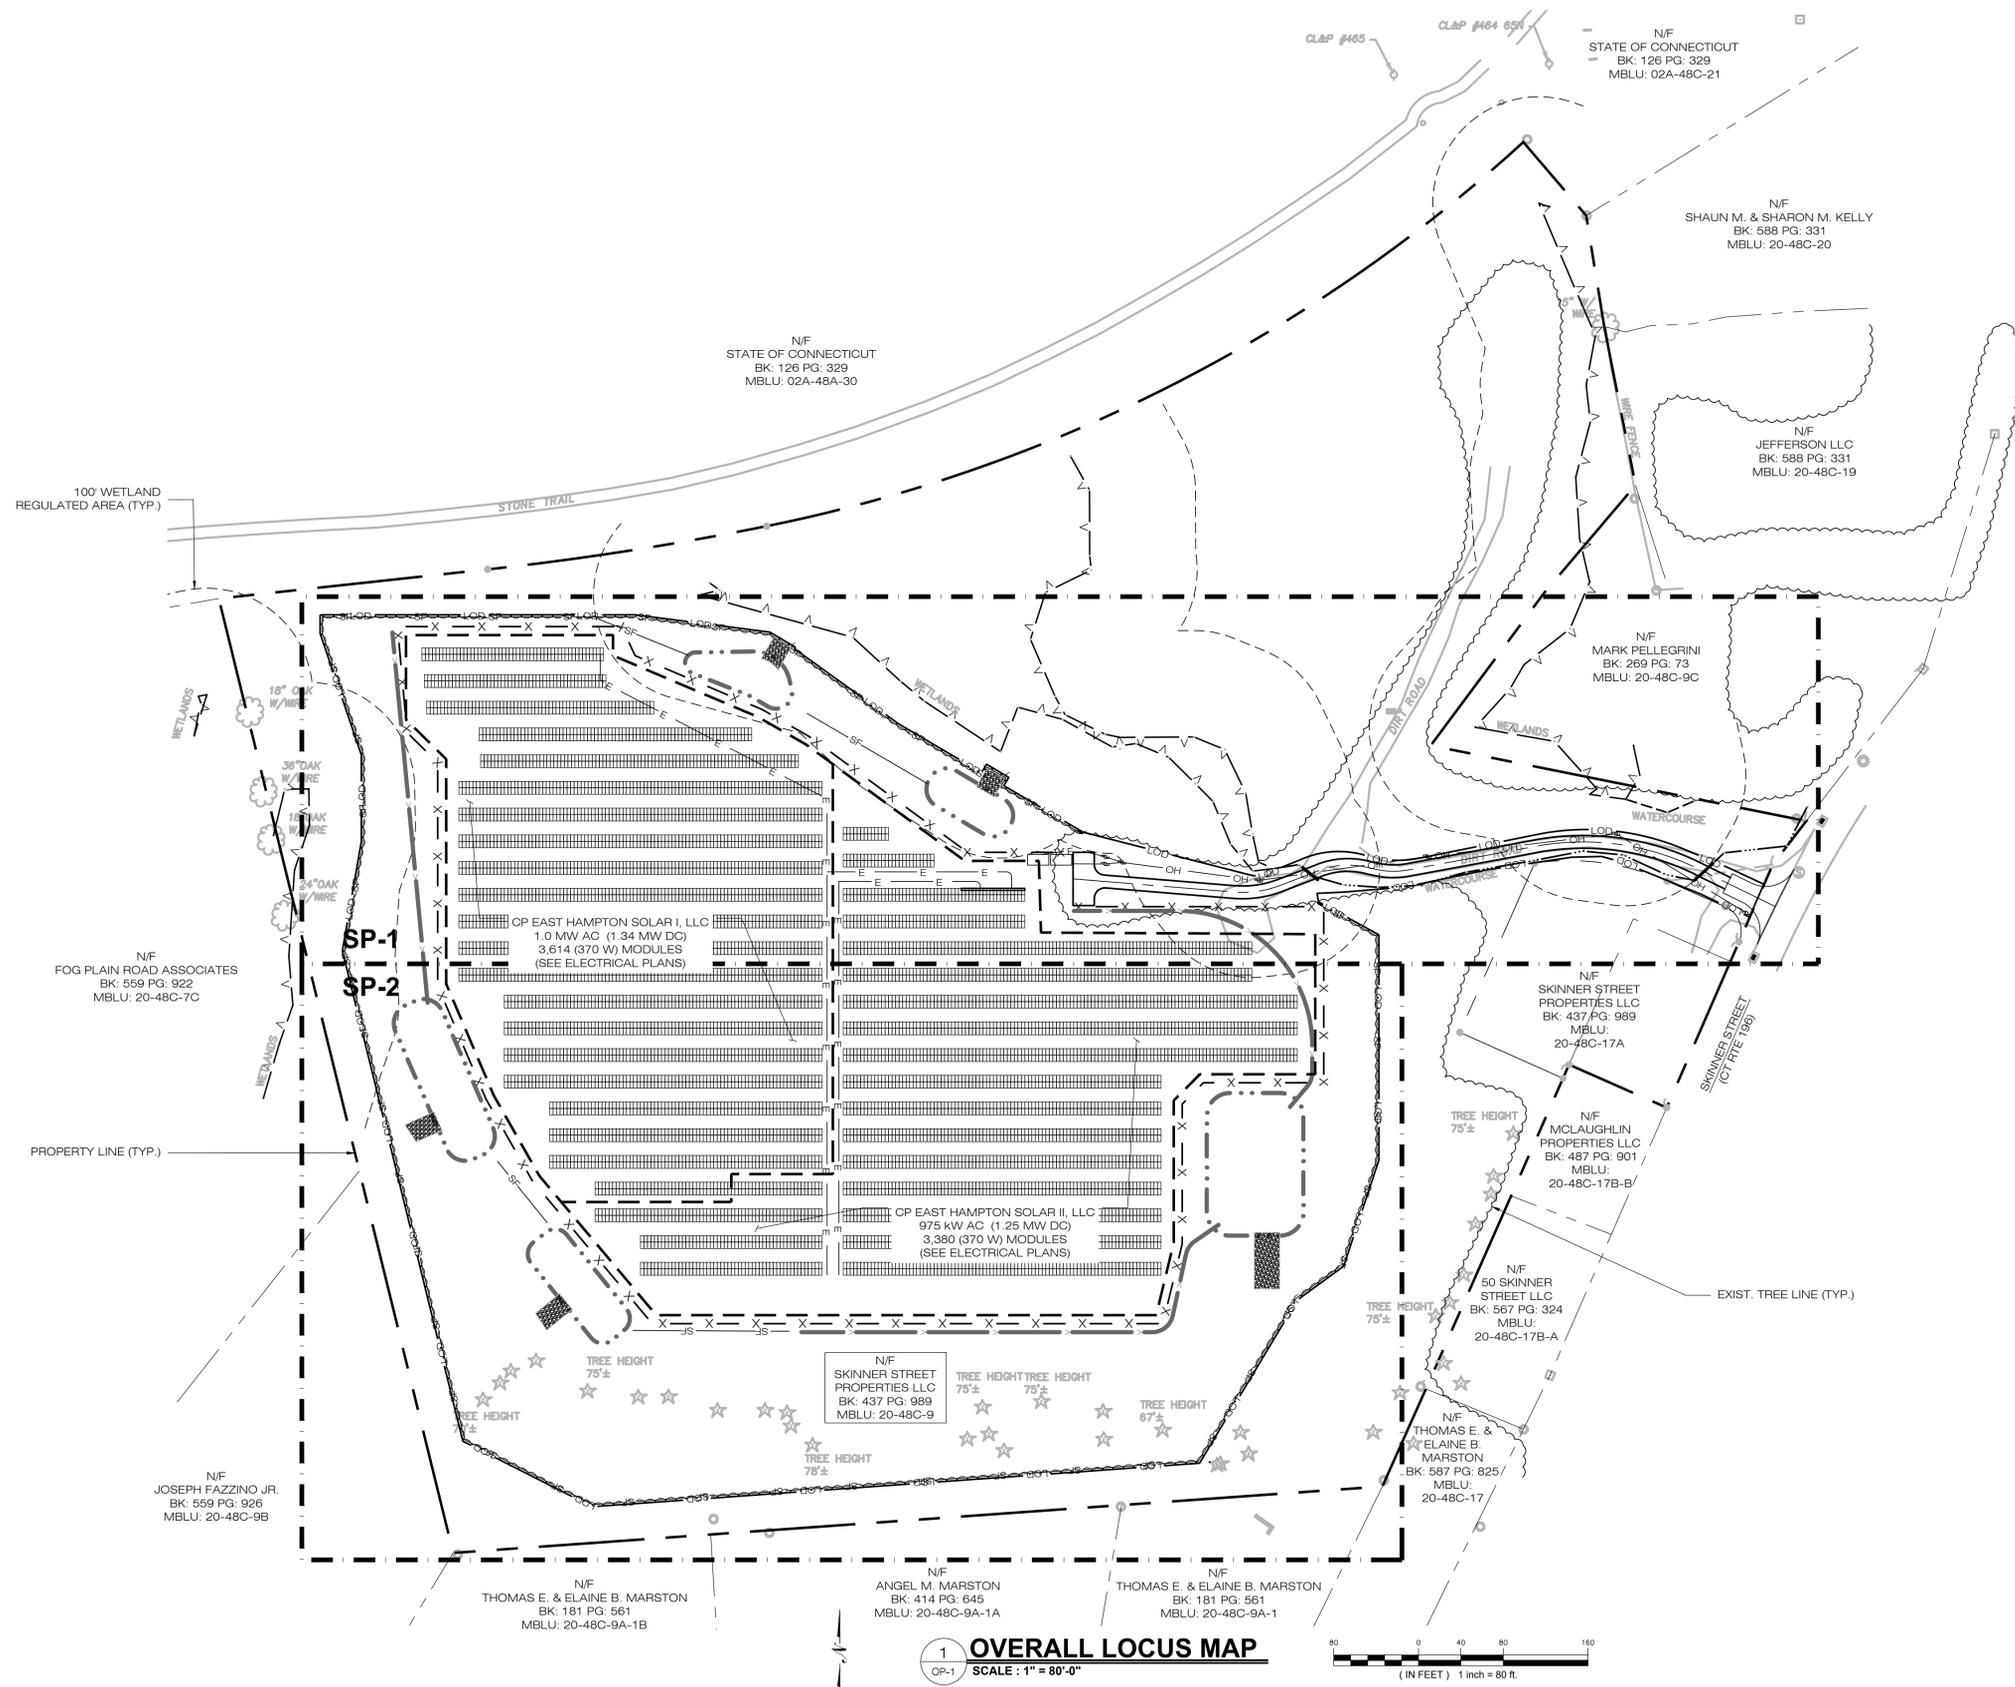

**CITRINE**  
 55 GREENS FARMS ROAD  
 WESTPORT, CT 06880  
 OFFICE: (203)-557-5554

**ALL-POINTS TECHNOLOGY CORPORATION**  
 3 SADDLEBROOK DRIVE PHONE: (860)-663-1697  
 KILLINGWORTH, CT 06419 FAX: (860)-663-0935  
 WWW.ALLPOINTSTECH.COM

**CSC PERMIT SET**

NO	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

**DESIGN PROFESSIONAL OF RECORD**  
 PROF: BRADLEY J. PARSONS P.E.  
 COMP: ALL-POINTS TECHNOLOGY CORPORATION  
 ADD: 3 SADDLEBROOK DRIVE  
 KILLINGWORTH, CT 06419

**OWNER:** SKINNER STREET PROPERTIES LLC  
 ADDRESS: 9 SEQUOIA TRAIL  
 EAST HAMPTON, CT 06424

**CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II**

**SITE** 46 SKINNER STREET  
 ADDRESS: EAST HAMPTON, CT 06424

**APT FILING NUMBER:** CT567110

**DATE:** 02/14/20 **DRAWN BY:** CSH  
**CHECKED BY:** BJP

**SHEET TITLE:**  
 OVERALL LOCUS MAP

**SHEET NUMBER:**  
 OP-1

**1 OVERALL LOCUS MAP**  
 OP-1 SCALE: 1" = 80'-0"

(IN FEET) 1 inch = 80 ft.

DESIGN TABLE:

MODULE MODEL - 370W TSM-DE15H (II)
PROP. TILT - 20 DEGREES
INTER-ROW SPACING - 13 FEET
DC OUTPUT - 2.59 MW
TOTAL NUMBER OF MODULES - 6,994 MODULES

**CITRINE**  
**55 GREENS FARMS ROAD**  
**WESTPORT, CT 06880**  
**OFFICE: (203)-557-5554**

**ALL-POINTS**  
 TECHNOLOGY CORPORATION  
 3 SADDLEBROOK DRIVE PHONE: (860)-663-1697  
 KILLINGWORTH, CT 06419 FAX: (860)-663-0935  
 WWW.ALLPOINTS TECH.COM

**CSC PERMIT SET**



NO	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

**DESIGN PROFESSIONAL OF RECORD**  
 PROF: BRADLEY J. PARSONS P.E.  
 COMP: ALL-POINTS TECHNOLOGY CORPORATION  
 ADD: 3 SADDLEBROOK DRIVE  
 KILLINGWORTH, CT 06419  
 OWNER: SKINNER STREET PROPERTIES LLC  
 ADDRESS: 9 SEQUONIA TRAIL  
 EAST HAMPTON, CT 06424


**CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II**  
 SITE ADDRESS: EAST HAMPTON, CT 06424  
 APT FILING NUMBER: CT567110  
 DATE: 02/14/20  
 DRAWN BY: CSH  
 CHECKED BY: BJP

SHEET TITLE:  
**SITE & UTILITY PLAN**

SHEET NUMBER:  
**SP-1**

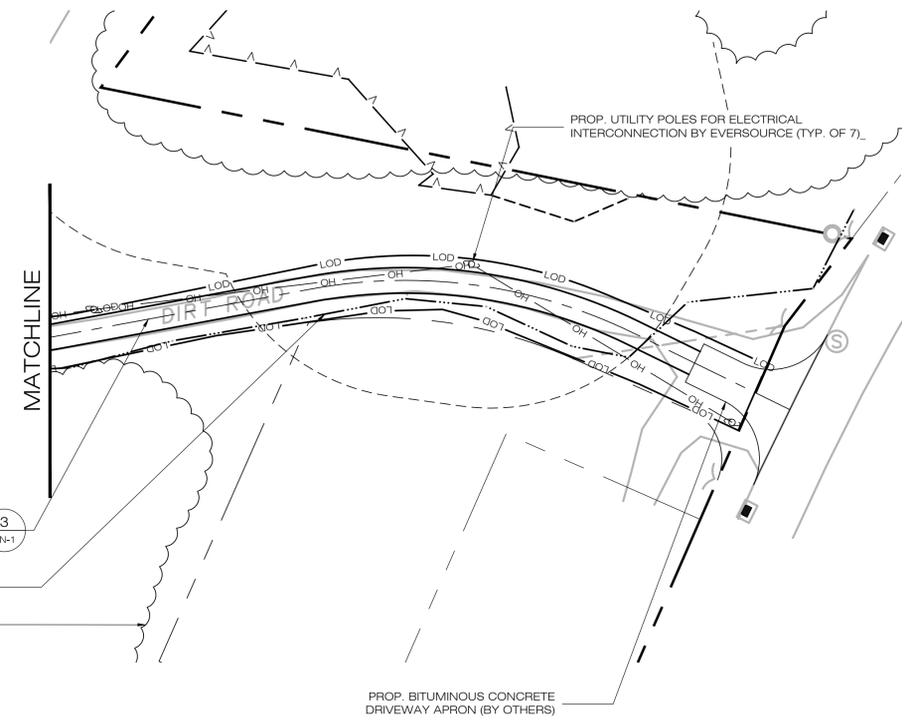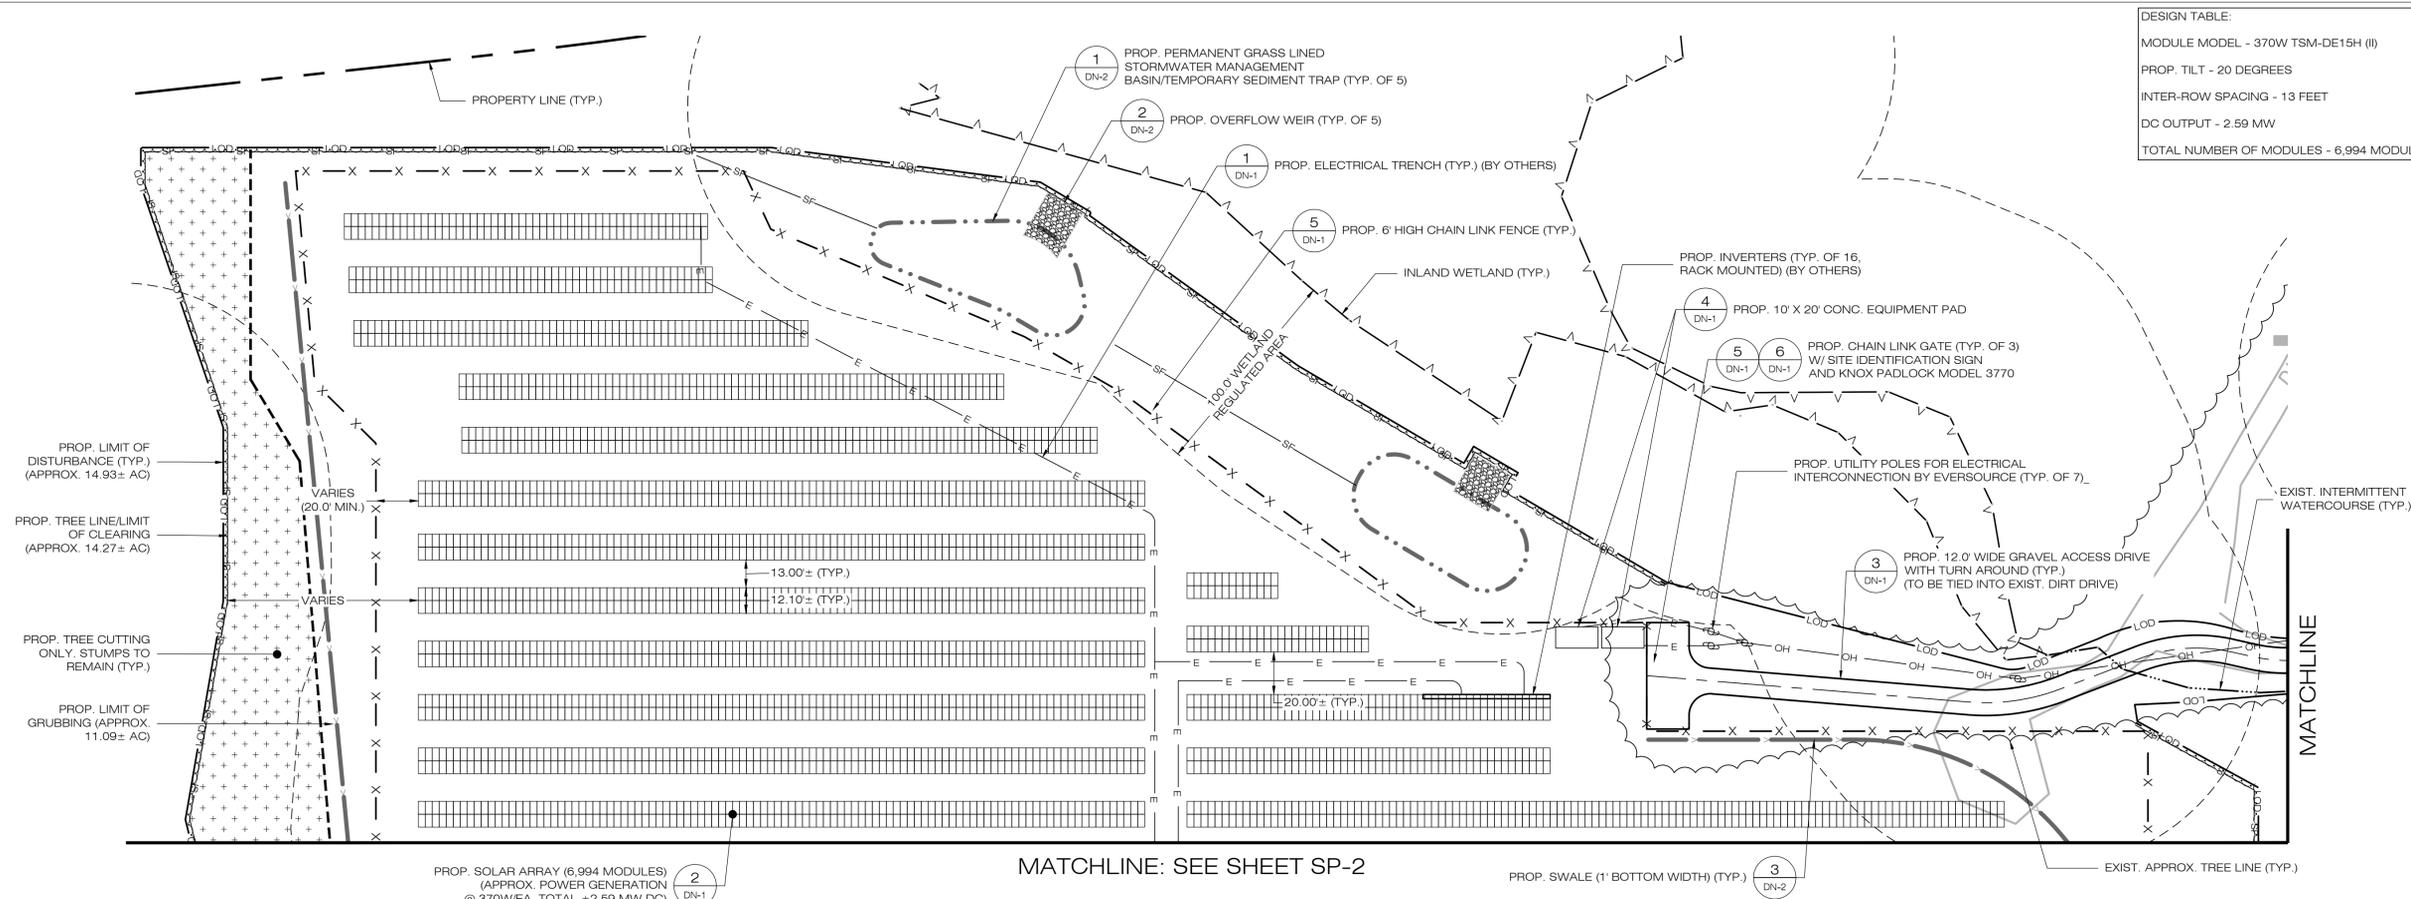

**1 SITE & UTILITY PLAN**  
 SP-1 SCALE: 1" = 40'-0"



DESIGN TABLE:  
 MODULE MODEL - 370W TSM-DE15H (II)  
 PROP. TILT - 20 DEGREES  
 INTER-ROW SPACING - 13 FEET  
 DC OUTPUT - 2.59 MW  
 TOTAL NUMBER OF MODULES - 6,994 MODULES

**CITRINE**  
 55 GREENS FARMS ROAD  
 WESTPORT, CT 06880  
 OFFICE: (203)-557-5554

**ALL-POINTS**  
 TECHNOLOGY CORPORATION  
 3 SADDLEBROOK DRIVE PHONE: (860)-663-1697  
 KILLINGWORTH, CT 06419 FAX: (860)-663-0935  
 WWW.ALLPOINTSTECH.COM

**CSC PERMIT SET**


NO	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

**DESIGN PROFESSIONAL OF RECORD**  
 PROF: BRADLEY J. PARSONS P.E.  
 COMP: ALL-POINTS TECHNOLOGY CORPORATION  
 ADD: 3 SADDLEBROOK DRIVE  
 KILLINGWORTH, CT 06419  
 OWNER: SKINNER STREET PROPERTIES LLC  
 ADDRESS: 9 SEQUONIA TRAIL  
 EAST HAMPTON, CT 06424


**CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II**  
 SITE ADDRESS: 46 SKINNER STREET  
 EAST HAMPTON, CT 06424  
 APT FILING NUMBER: CT567110  
 DATE: 02/14/20  
 DRAWN BY: CSH  
 CHECKED BY: BJP



SHEET TITLE:  
**SITE & UTILITY PLAN**

SHEET NUMBER:  
**SP-2**

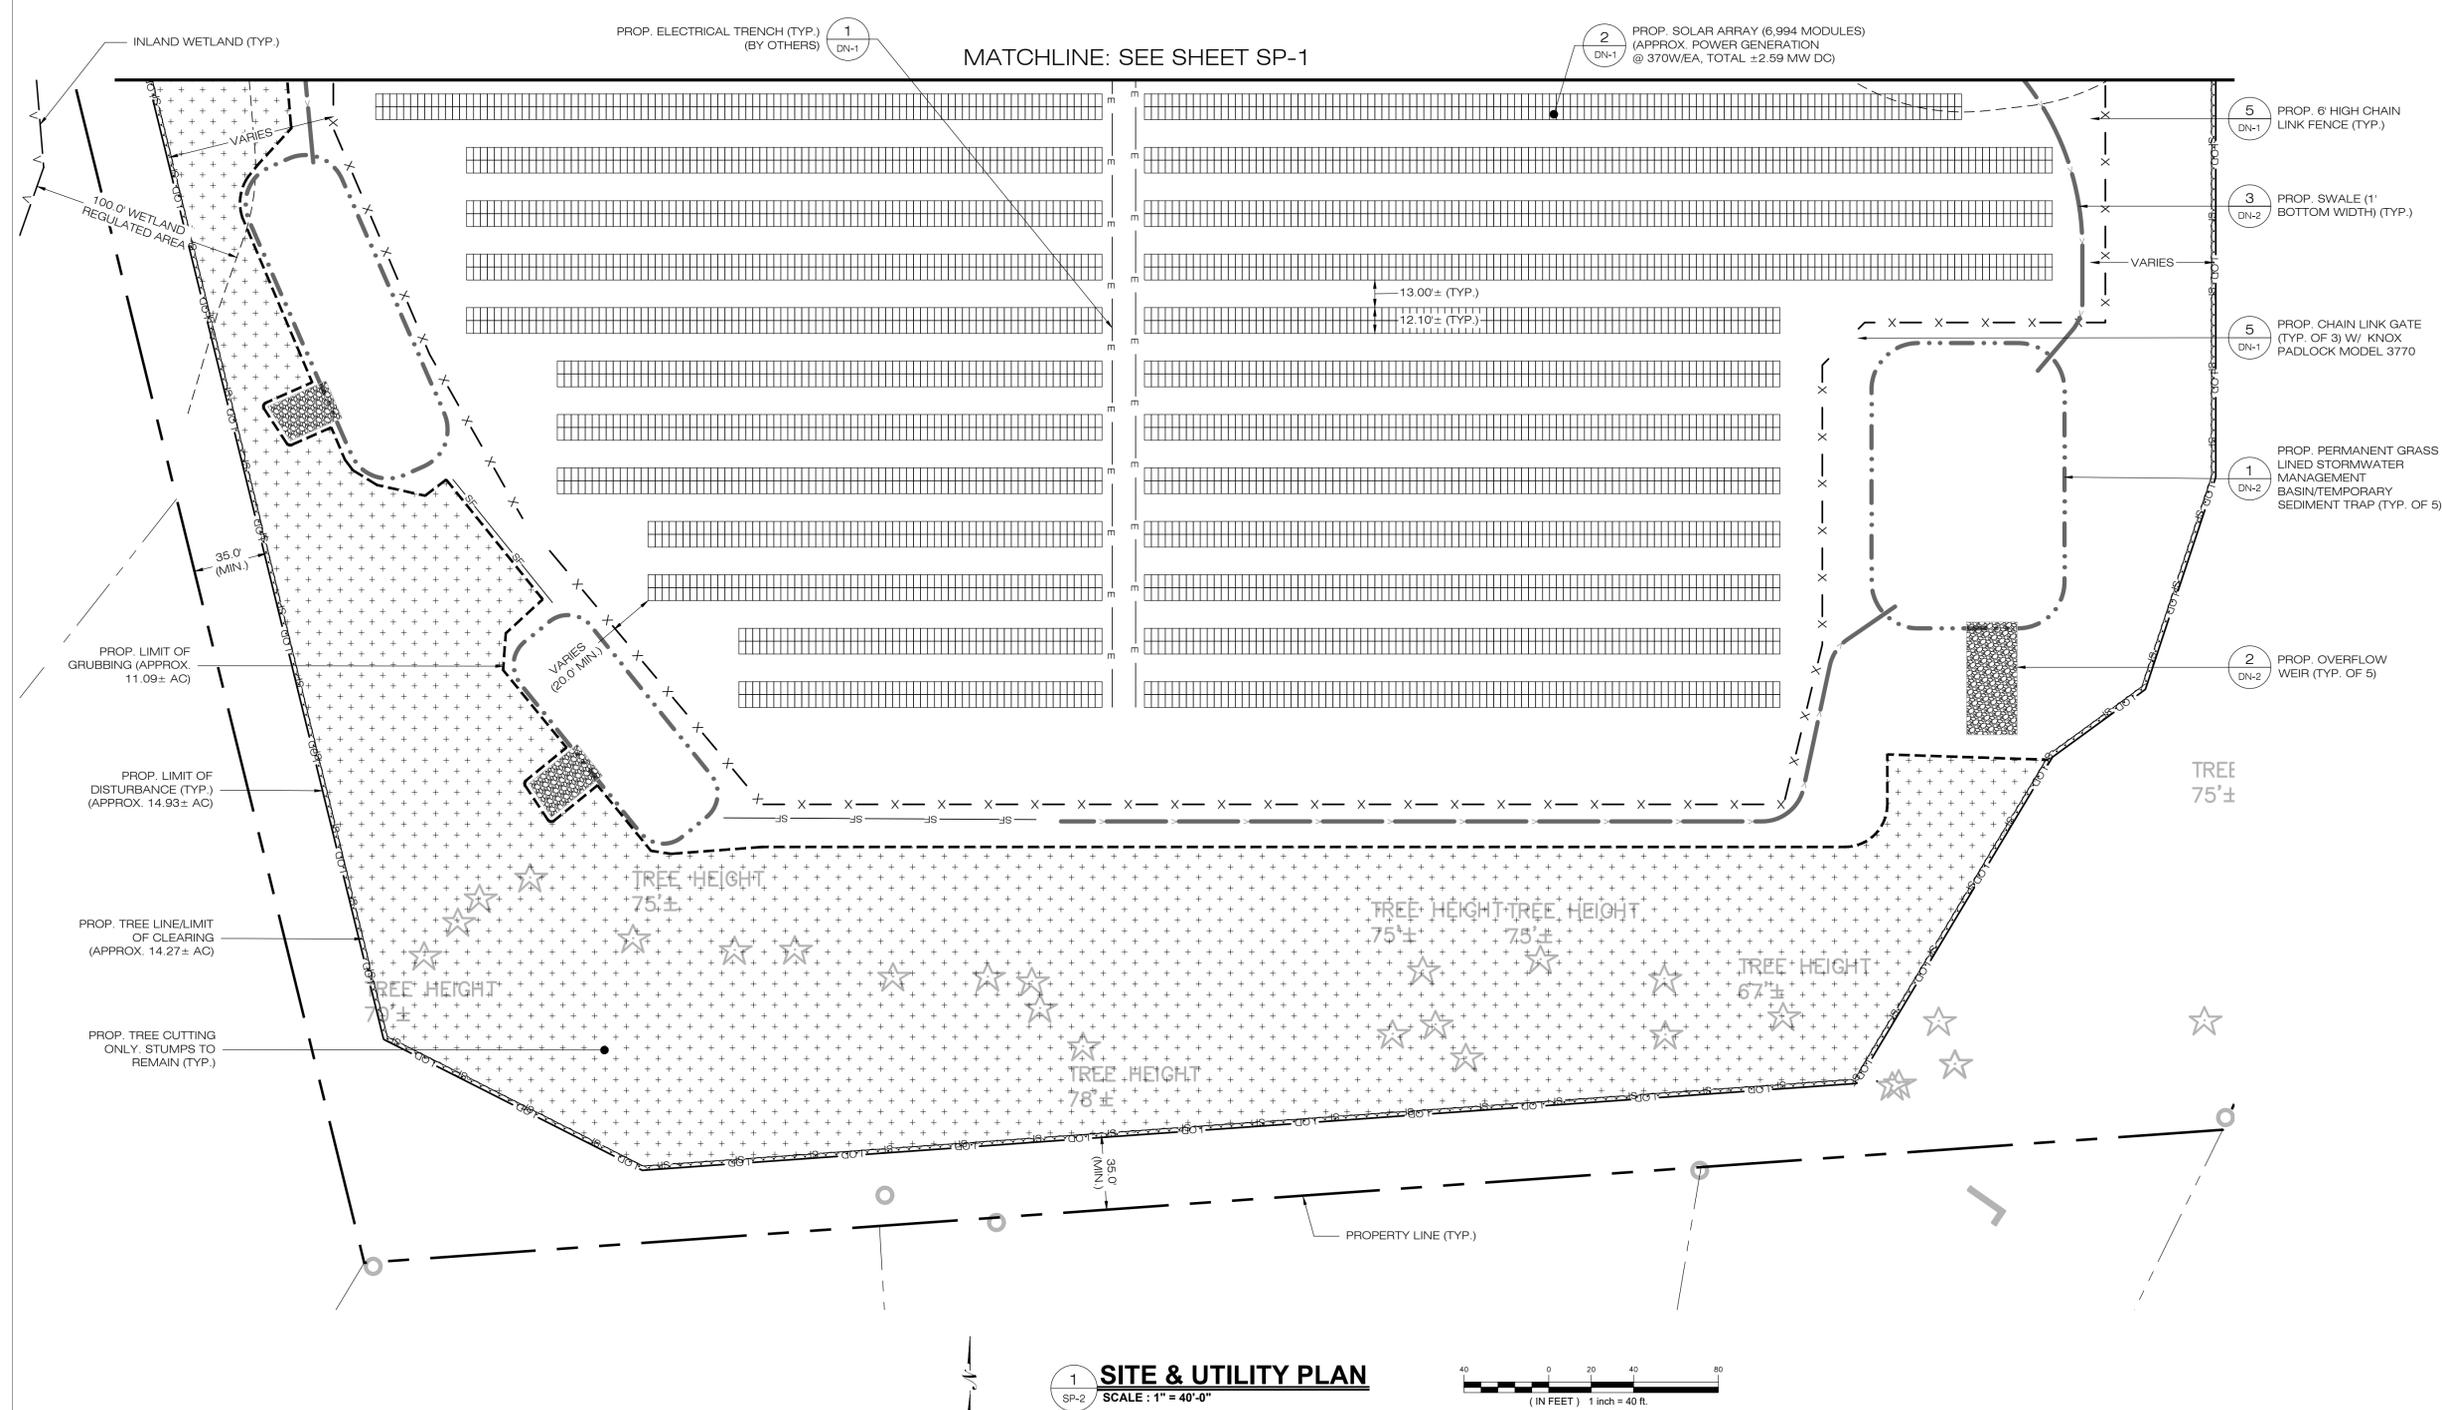

**1 SITE & UTILITY PLAN**  
 SP-2 SCALE: 1" = 40'-0"



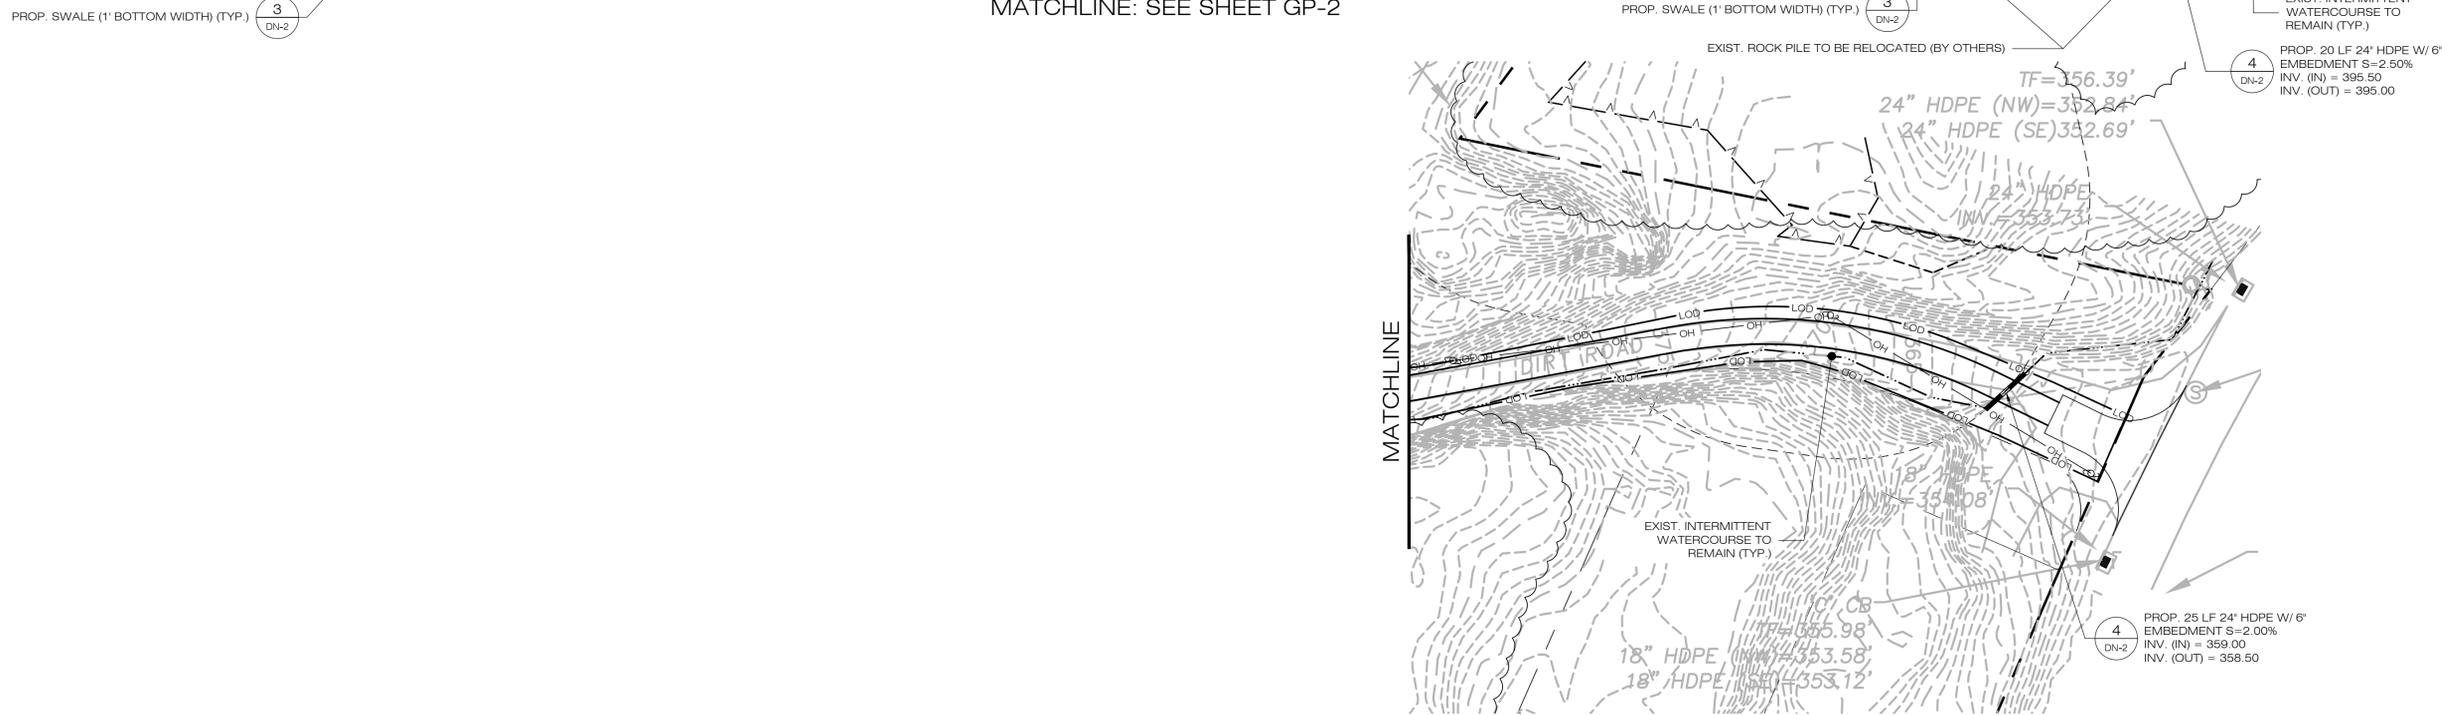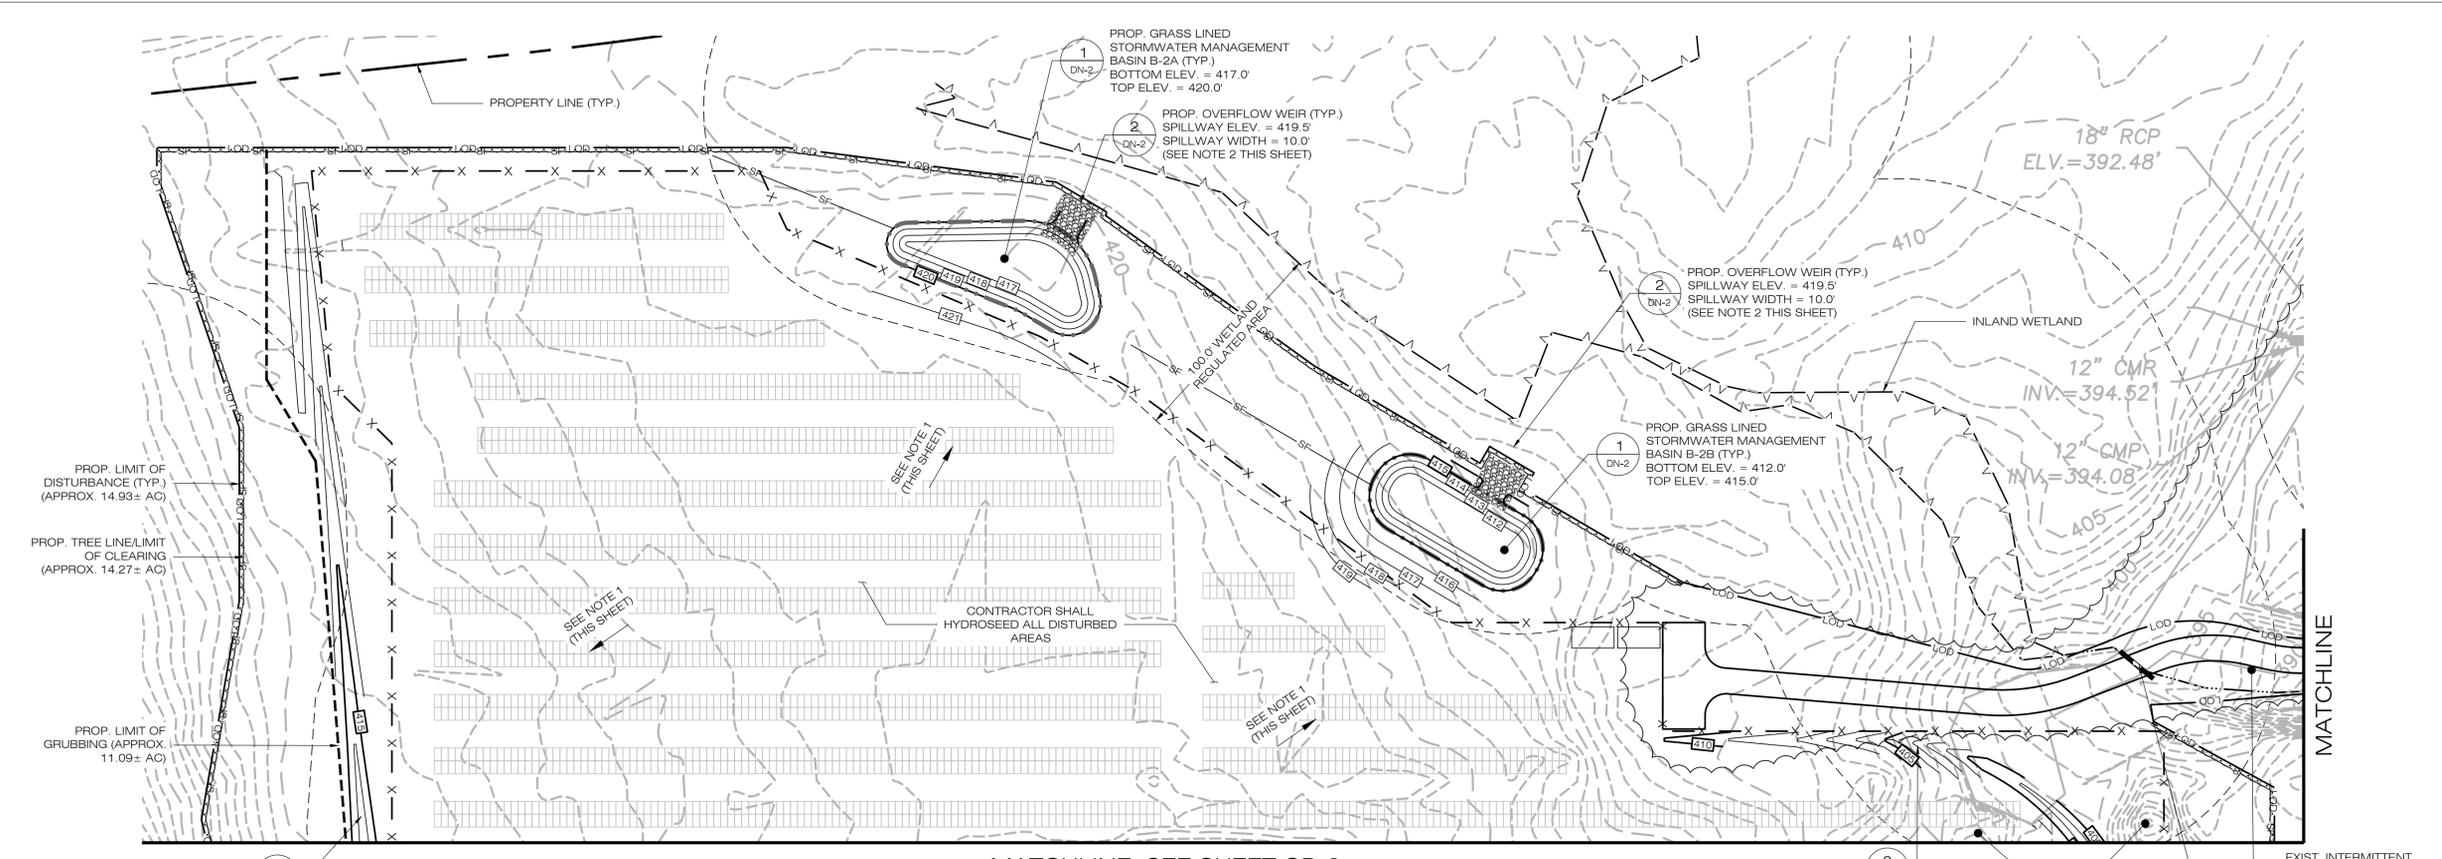

**1** GP-1 **GRADING & DRAINAGE PLAN**  
 SCALE: 1" = 40'-0"

(IN FEET) 1 inch = 40 ft.

**NOTES:**  
 1. GRADE/SHAPE DISTURBED AREA TO MATCH EXISTING GRADE AND FLOW TOWARDS PROP. GRASS LINED STORMWATER MANAGEMENT BASINS.  
 2. CONTRACTOR SHALL REPLACE TEMPORARY SEDIMENT TRAP OUTLET WITH RIP-RAP OVERFLOW WEIR UPON THE SITE OR DRAINAGE AREA BEING DEEMED STABILIZED PER THE SWPCP.

**CITRINE**  
 55 GREENS FARMS ROAD  
 WESTPORT, CT 06880  
 OFFICE: (203)-557-5554

**ALL-POINTS TECHNOLOGY CORPORATION**  
 3 SADDLEBROOK DRIVE PHONE: (860)-663-1697  
 KILLINGWORTH, CT 06419 FAX: (860)-663-0935  
 WWW.ALLPOINTSCT.COM

**CSC PERMIT SET**

NO	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

**DESIGN PROFESSIONAL OF RECORD**  
 PROF: BRADLEY J. PARSONS P.E.  
 COMP: ALL-POINTS TECHNOLOGY CORPORATION  
 ADD: 3 SADDLEBROOK DRIVE  
 KILLINGWORTH, CT 06419

**OWNER:** SKINNER STREET PROPERTIES LLC  
 ADDRESS: 9 SEQUONIA TRAIL  
 EAST HAMPTON, CT 06424

**CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II**  
 SITE ADDRESS: EAST HAMPTON, CT 06424  
 APT FILING NUMBER: CT567110  
 DATE: 02/14/20  
 DRAWN BY: CSH  
 CHECKED BY: BJP

**SHEET TITLE:**  
 GRADING & DRAINAGE PLAN

**SHEET NUMBER:**  
 GP-1



55 GREENS FARMS ROAD  
WESTPORT, CT 06880  
OFFICE: (203)-557-5554



3 SADDLEBROOK DRIVE PHONE: (860)-663-1697  
KILLINGWORTH, CT 06419 FAX: (860)-663-0935  
WWW.ALLPOINTSTECH.COM

CSC PERMIT SET

NO	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

DESIGN PROFESSIONAL OF RECORD

PROF: BRADLEY J. PARSONS P.E.  
COMP: ALL-POINTS TECHNOLOGY CORPORATION  
ADD: 3 SADDLEBROOK DRIVE  
KILLINGWORTH, CT 06419

OWNER: SKINNER STREET PROPERTIES LLC  
ADDRESS: 9 SEQUOIA TRAIL  
EAST HAMPTON, CT 06424

CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II

SITE ADDRESS: EAST HAMPTON, CT 06424

APT FILING NUMBER: CT567110


DRAWN BY: CSH

DATE: 02/14/20 CHECKED BY: BJP

SHEET TITLE:  
**GRADING & DRAINAGE PLAN**

SHEET NUMBER:

**GP-2**

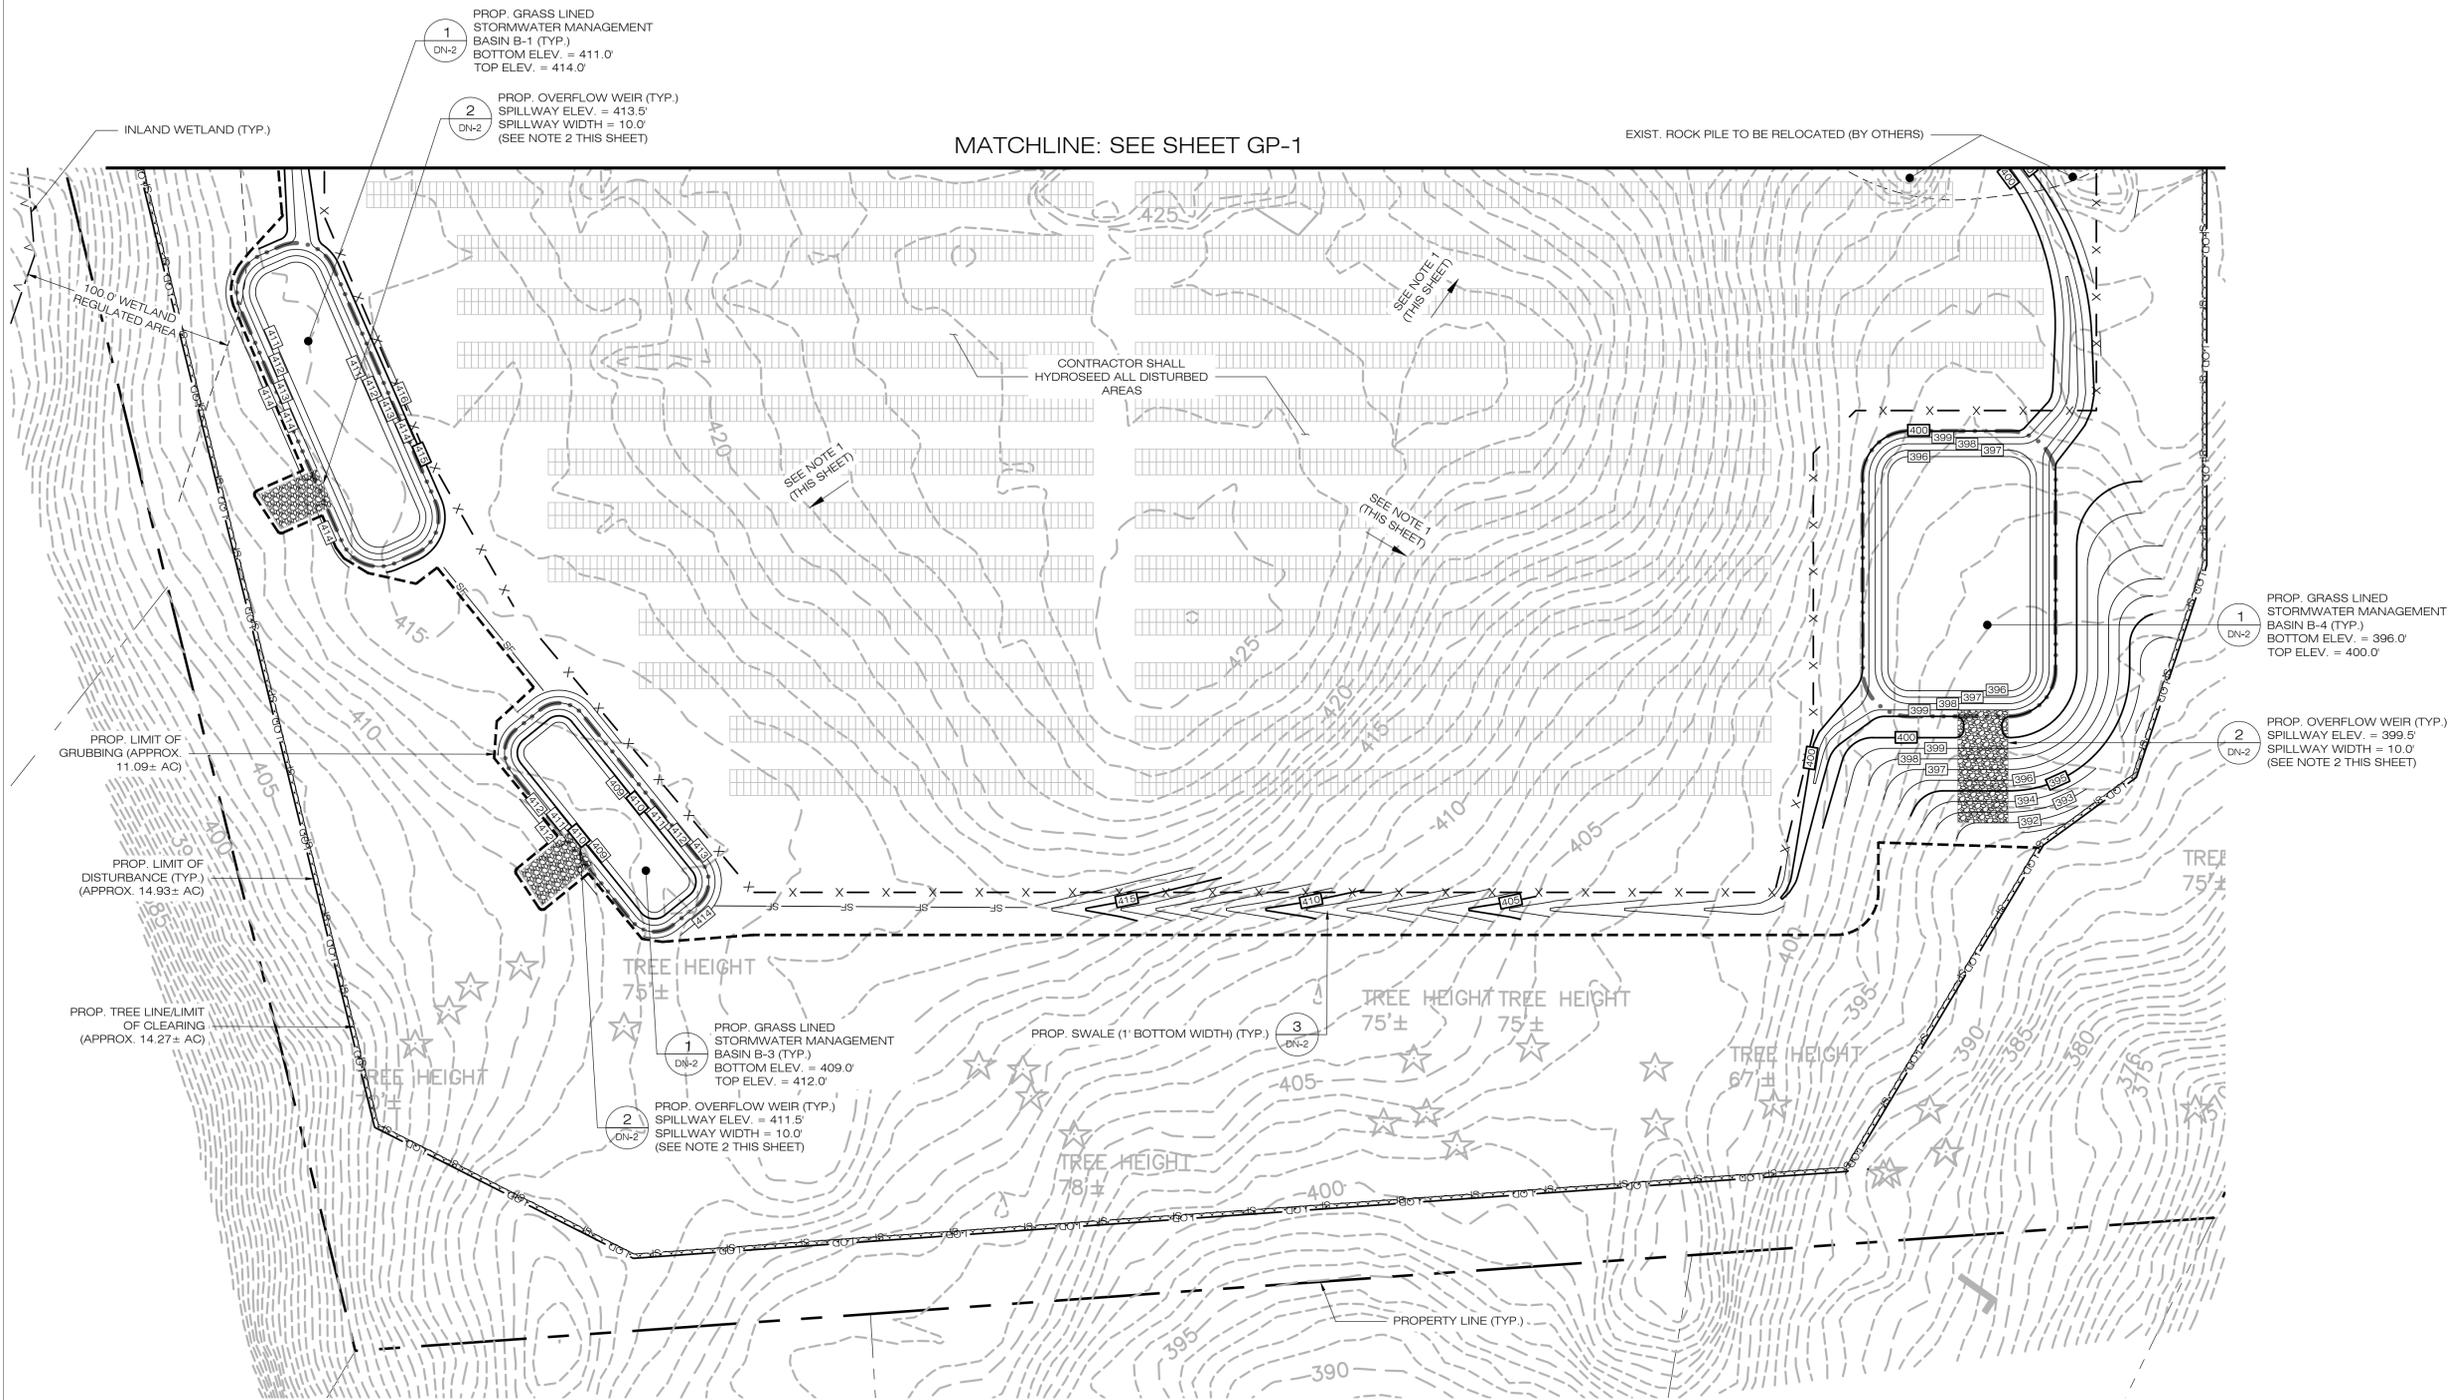


MATCHLINE: SEE SHEET GP-1

EXIST. ROCK PILE TO BE RELOCATED (BY OTHERS)

**1 GRADING & DRAINAGE PLAN**

GP-2 SCALE: 1" = 40'-0"



- NOTES:
- GRADE/SHAPE DISTURBED AREA TO MATCH EXISTING GRADE AND FLOW TOWARDS PROP. GRASS LINED STORMWATER MANAGEMENT BASINS.
  - CONTRACTOR SHALL REPLACE TEMPORARY SEDIMENT TRAP OUTLET WITH RIP-RAP OVERFLOW WEIR UPON THE SITE OR DRAINAGE AREA BEING DEEMED STABILIZED PER THE SWPCP.

**CSC PERMIT SET**

NO	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

**DESIGN PROFESSIONAL OF RECORD**

PROF: BRADLEY J. PARSONS P.E.  
COMP: ALL-POINTS TECHNOLOGY CORPORATION  
ADD: 3 SADDLEBROOK DRIVE  
KILLINGWORTH, CT 06419

OWNER: SKINNER STREET PROPERTIES LLC  
ADDRESS: 9 SEQUONIA TRAIL  
EAST HAMPTON, CT 06424

**CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II**

SITE ADDRESS: EAST HAMPTON, CT 06424


APT FILING NUMBER: CT567110

DATE: 02/14/20  
DRAWN BY: CSH  
CHECKED BY: BJP

SHEET TITLE:  
**SEDIMENTATION & EROSION CONTROL PLAN (PHASE 1)**

SHEET NUMBER:

**EC-1**

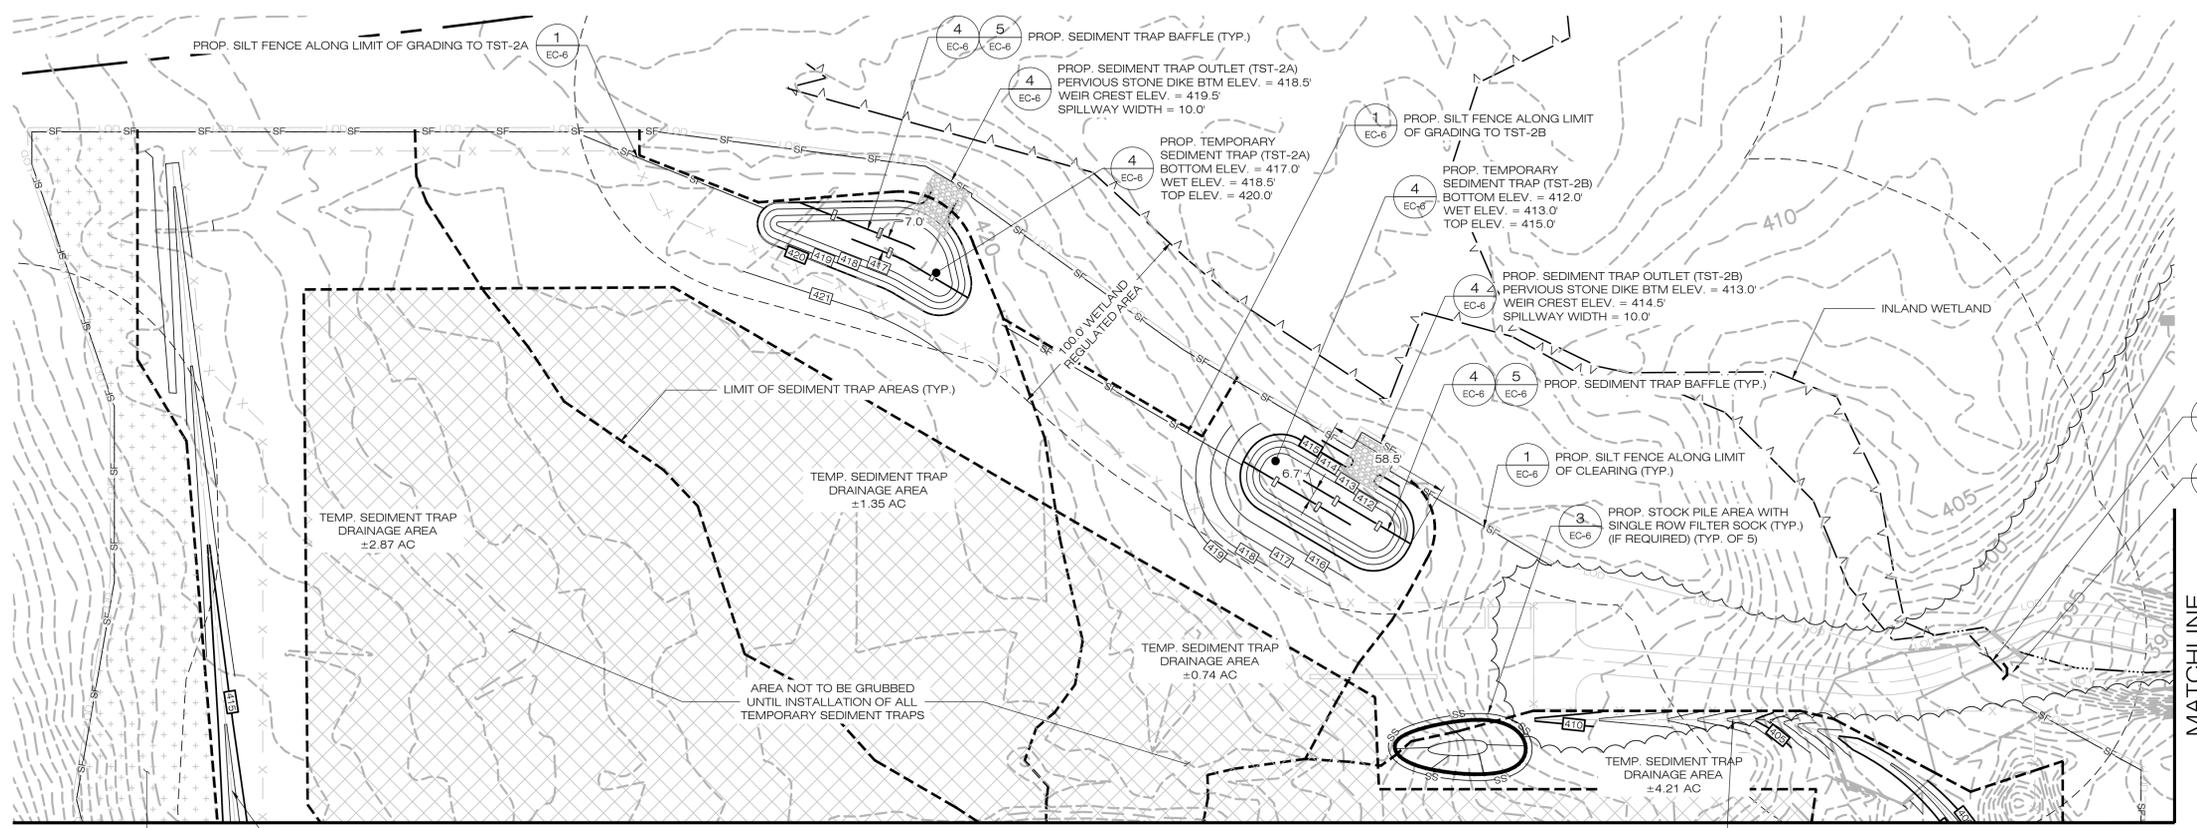



PROP. PHASE 1 CLEARING ONLY (3.21 ± AC.)  
CLEARING ACTIVITIES TO INCLUDE THE REMOVAL  
OF ALL BRUSH & TREES. ALL STUMPS TO REMAIN  
CLEARED MATERIAL TO BE CHIPPED & STOCKPILED,  
TO BE USED FOR TEMPORARY STABILIZATION. (TYP.)

MATCHLINE: SEE SHEET EC-2




**1 SEDIMENTATION & EROSION CONTROL PLAN**  
SCALE: 1" = 40'-0"



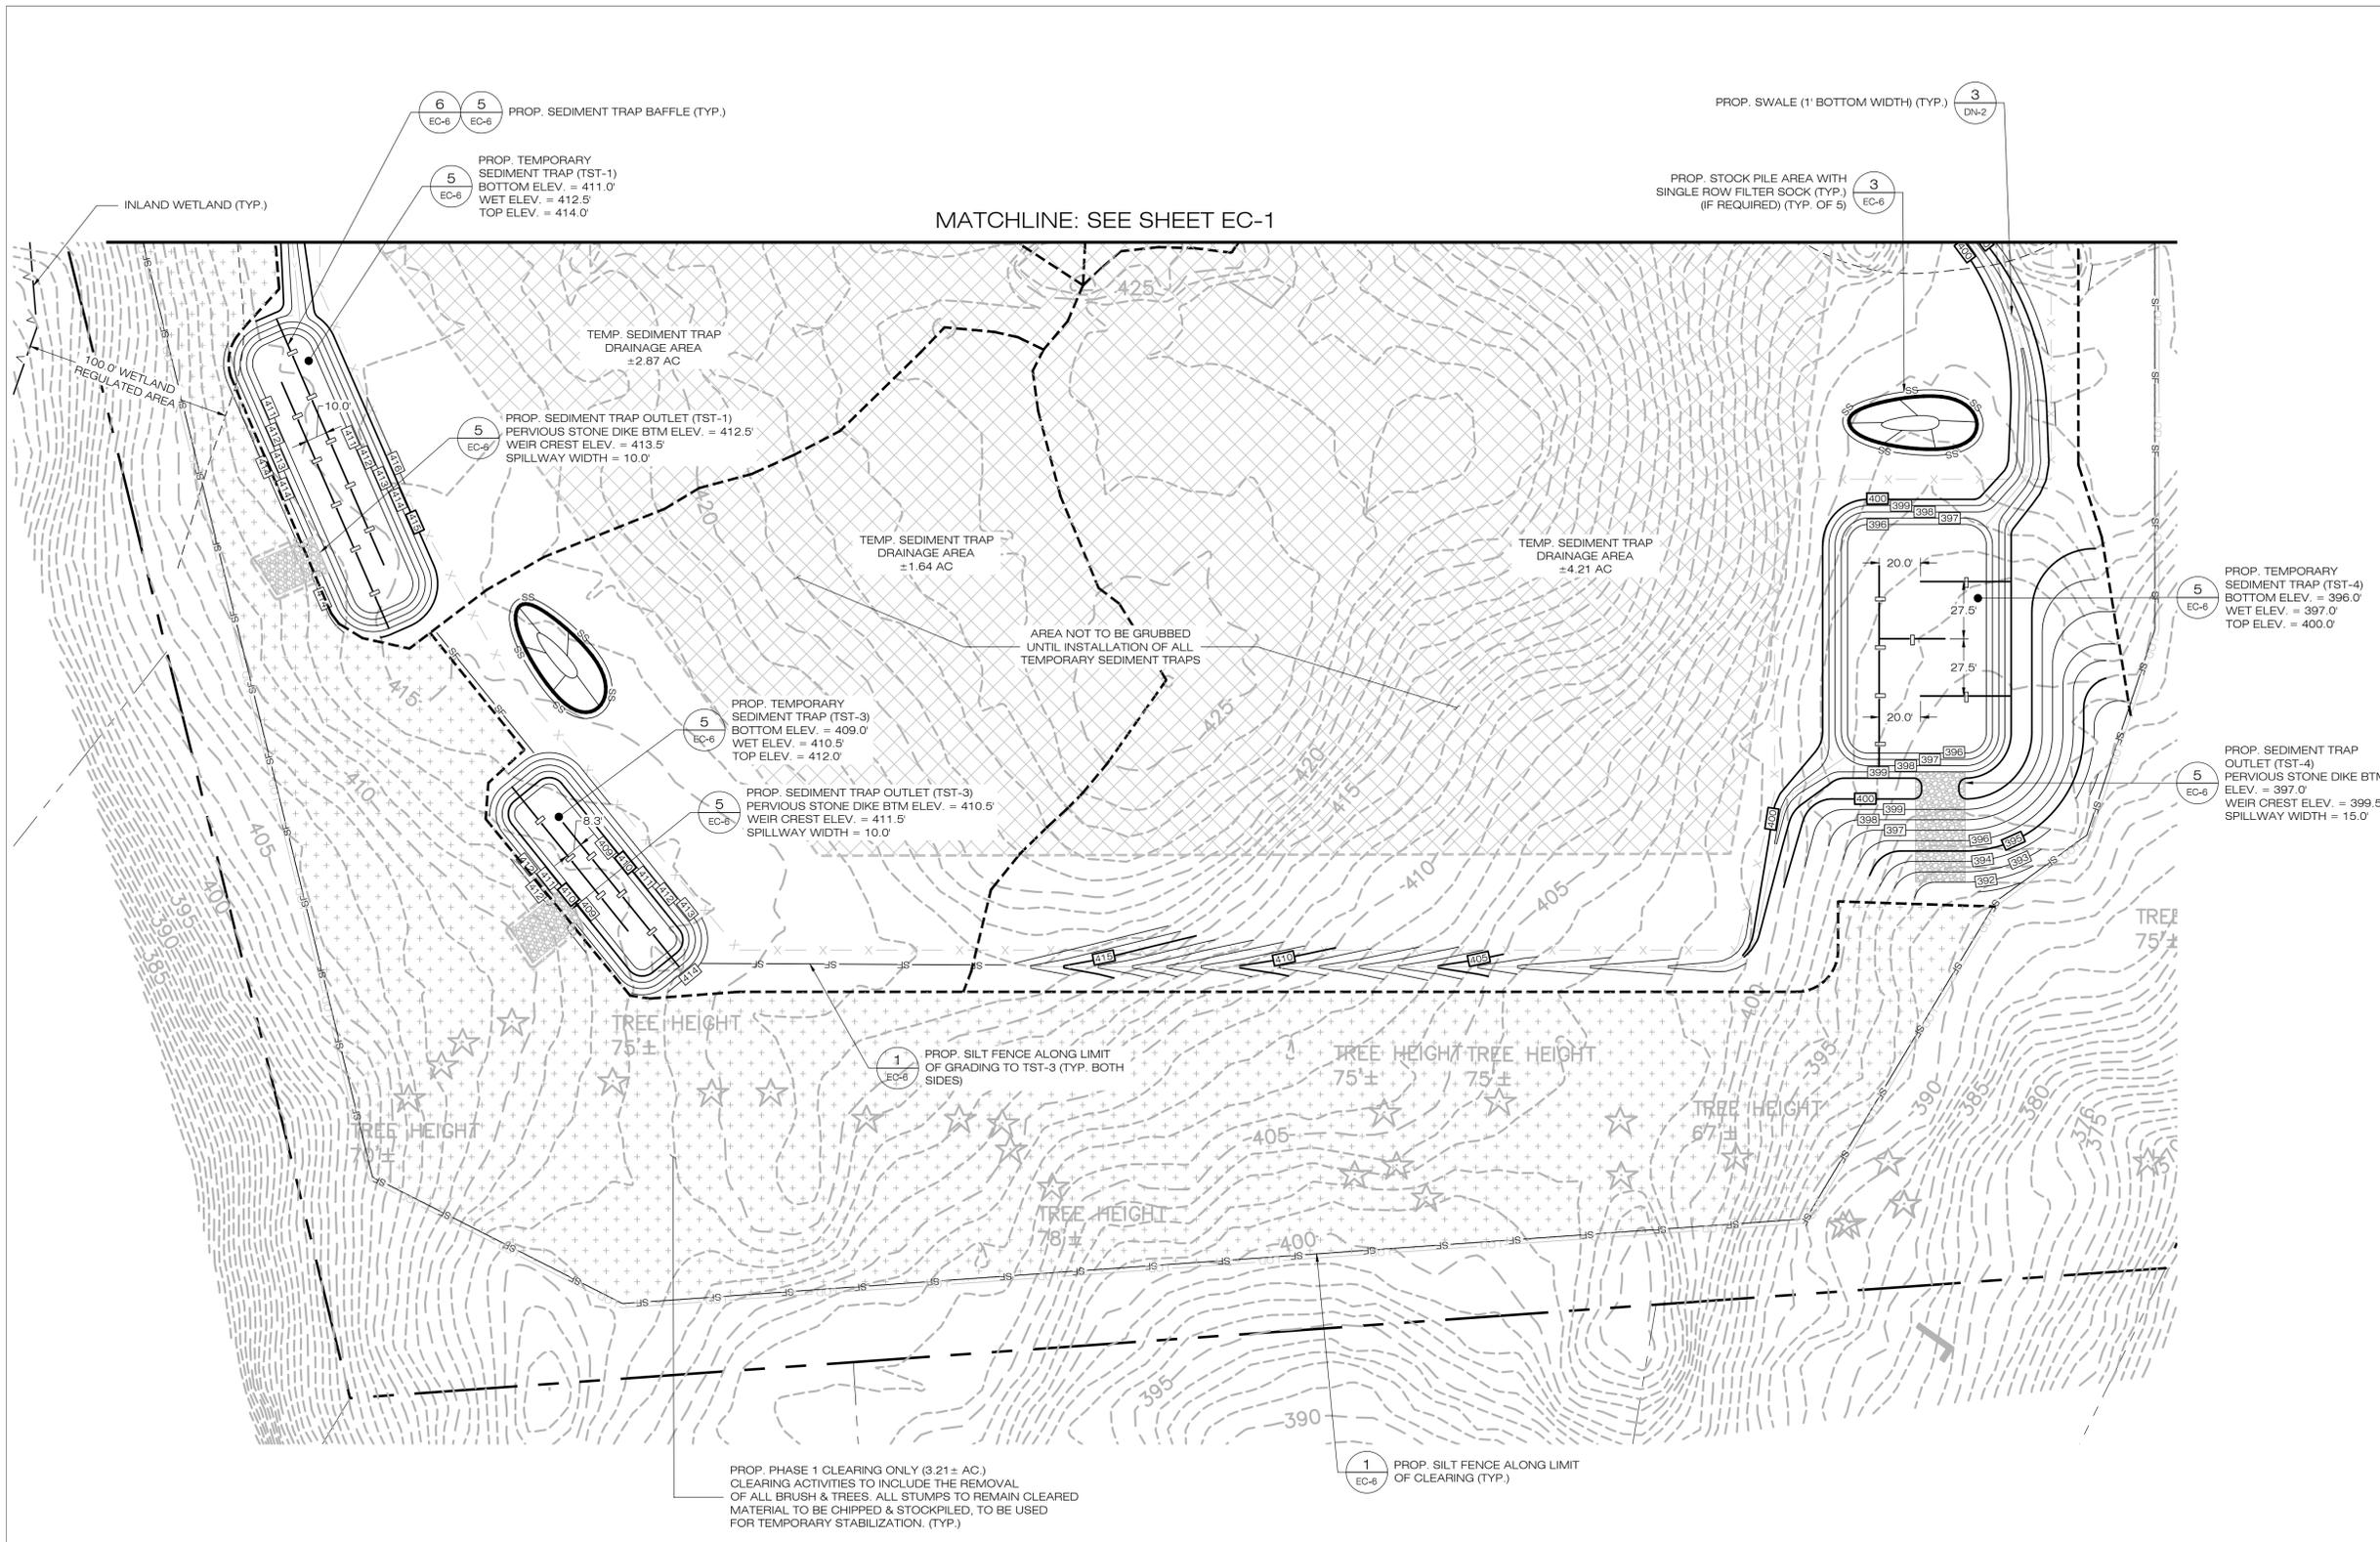

MATCHLINE: SEE SHEET EC-1

**1** **SEDIMENTATION & EROSION CONTROL PLAN**  
 EC-2 SCALE: 1" = 40'-0"



**CITRINE**  
 55 GREENS FARMS ROAD  
 WESTPORT, CT 06880  
 OFFICE: (203)-557-5554

**ALL-POINTS TECHNOLOGY CORPORATION**  
 3 SADDLEBROOK DRIVE PHONE: (860)-663-1697  
 KILLINGWORTH, CT 06419 FAX: (860)-663-0935  
 WWW.ALLPOINTSTECH.COM

**CSC PERMIT SET**

NO	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

**DESIGN PROFESSIONAL OF RECORD**  
 PROF: BRADLEY J. PARSONS P.E.  
 COMP: ALL-POINTS TECHNOLOGY CORPORATION  
 ADD: 3 SADDLEBROOK DRIVE  
 KILLINGWORTH, CT 06419


**OWNER:** SKINNER STREET PROPERTIES LLC  
 ADDRESS: 9 SEQUONIA TRAIL  
 EAST HAMPTON, CT 06424

**CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II**  
 SITE ADDRESS: EAST HAMPTON, CT 06424  
 APT FILING NUMBER: CT567110


DATE: 02/14/20 DRAWN BY: CSH CHECKED BY: BJP

**SHEET TITLE:**  
**SEDIMENTATION & EROSION CONTROL PLAN (PHASE 1)**


**SHEET NUMBER:**  
**EC-2**

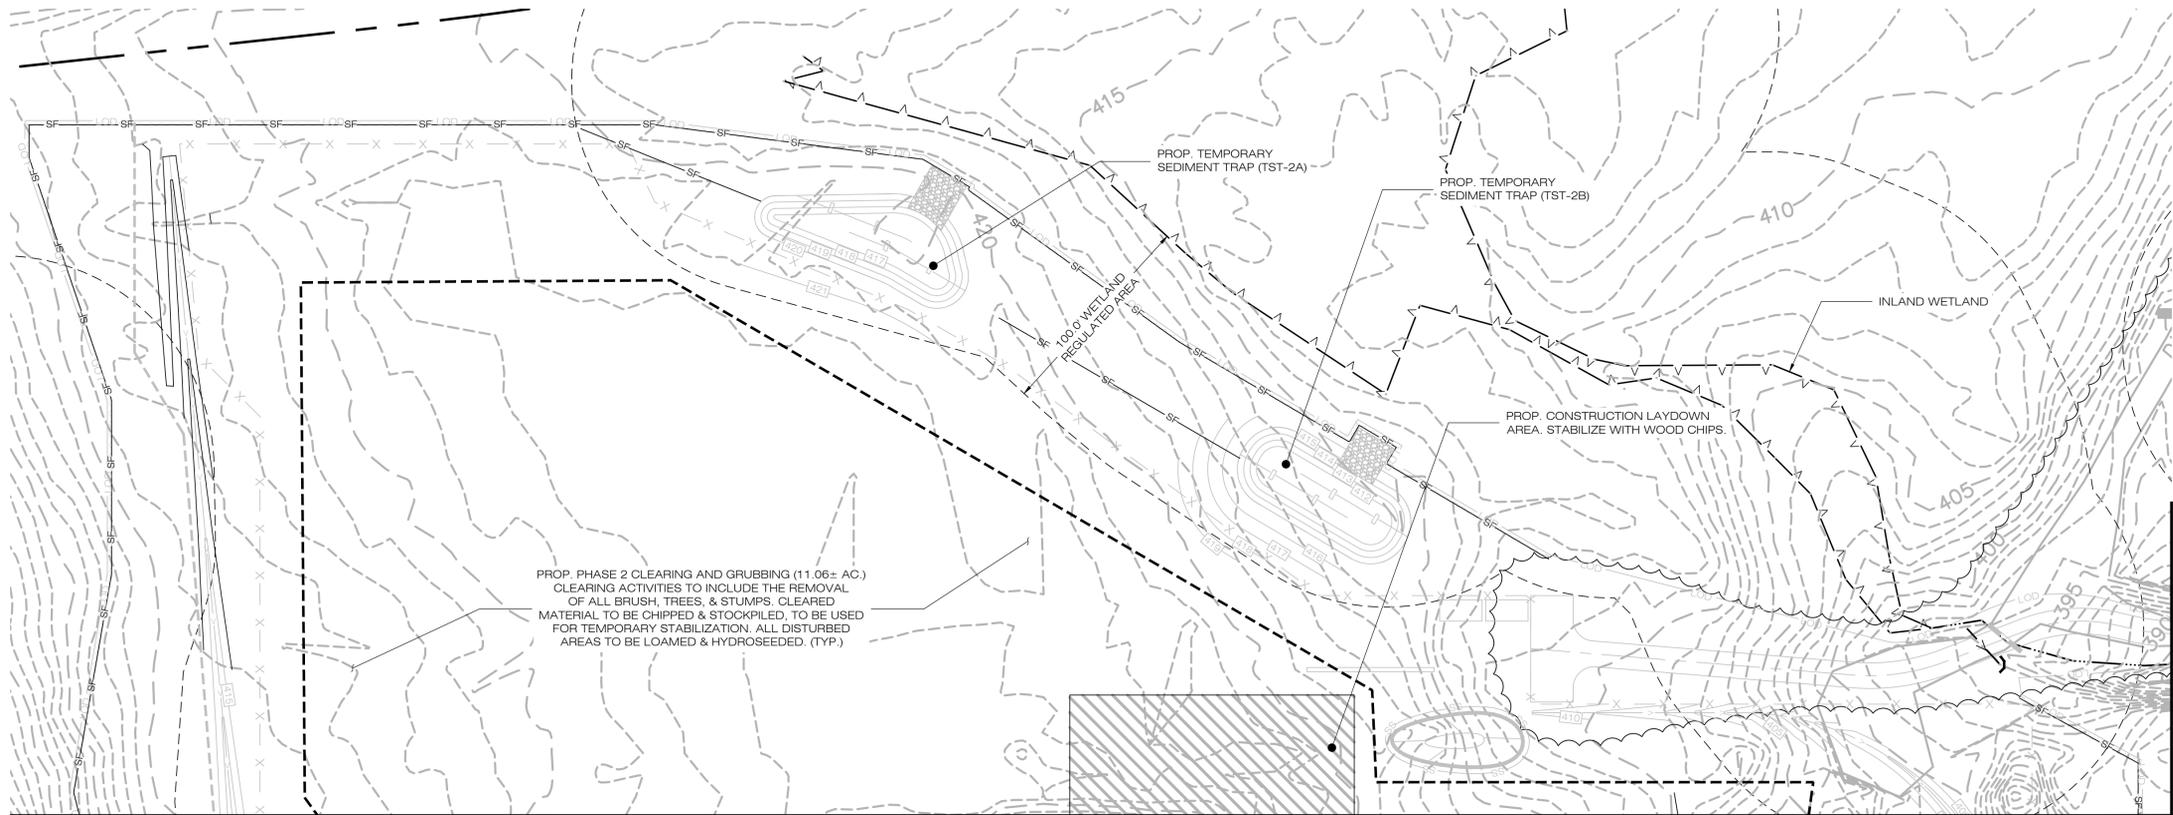

MATCHLINE: SEE SHEET EC-4

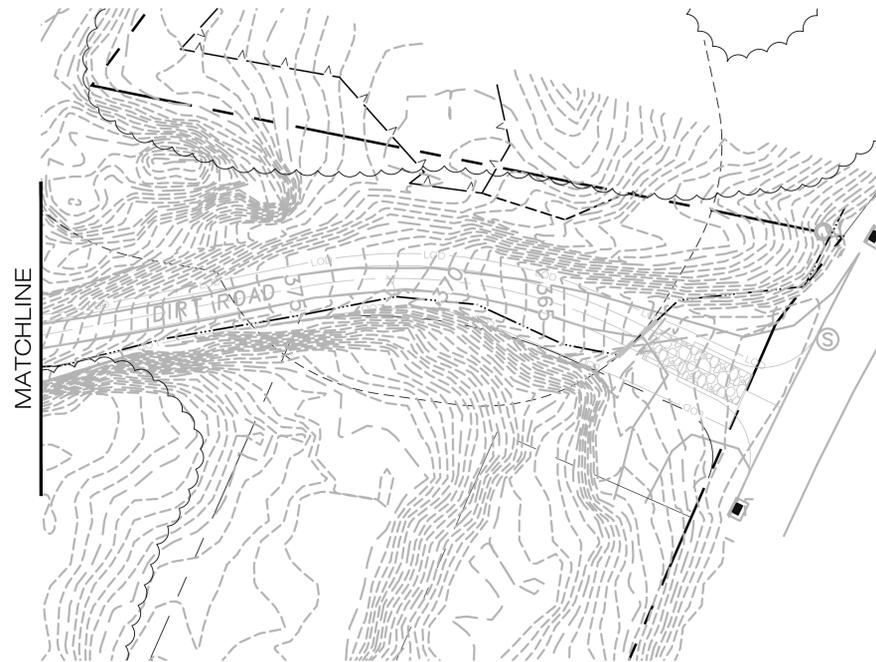

**1**  
 EC-3 **SEDIMENTATION & EROSION CONTROL PLAN**  
 SCALE: 1" = 40'-0"



55 GREENS FARMS ROAD  
 WESTPORT, CT 06880  
 OFFICE: (203)-557-5554



3 SADDLEBROOK DRIVE PHONE: (860)-663-1697  
 KILLINGWORTH, CT 06419 FAX: (860)-663-0935  
 WWW.ALLPOINTSTECH.COM

**CSC PERMIT SET**

NO.	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

**DESIGN PROFESSIONAL OF RECORD**

PROF: BRADLEY J. PARSONS P.E.  
 COMP: ALL-POINTS TECHNOLOGY  
 CORPORATION  
 ADD: 3 SADDLEBROOK DRIVE  
 KILLINGWORTH, CT 06419

OWNER: SKINNER STREET  
 PROPERTIES LLC  
 ADDRESS: 9 SEQUONIA TRAIL  
 EAST HAMPTON, CT 06424

**CP EAST HAMPTON SOLAR I &  
 CP EAST HAMPTON SOLAR II**

SITE: 46 SKINNER STREET  
 ADDRESS: EAST HAMPTON, CT 06424


APT FILING NUMBER: CT567110

DATE: 02/14/20  
 DRAWN BY: CSH  
 CHECKED BY: BJP

SHEET TITLE:  
**SEDIMENTATION &  
 EROSION CONTROL PLAN  
 (PHASE 2)**

SHEET NUMBER:

**EC-3**





55 GREENS FARMS ROAD  
WESTPORT, CT 06880  
OFFICE: (203)-557-5554



3 SADDLEBROOK DRIVE PHONE: (860)-663-1697  
KILLINGWORTH, CT 06419 FAX: (860)-663-0935  
WWW.ALLPOINTSTECH.COM

CSC PERMIT SET

NO	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

DESIGN PROFESSIONAL OF RECORD

PROF: BRADLEY J. PARSONS P.E.  
COMP: ALL-POINTS TECHNOLOGY CORPORATION  
ADD: 3 SADDLEBROOK DRIVE  
KILLINGWORTH, CT 06419

OWNER: SKINNER STREET PROPERTIES LLC  
ADDRESS: 9 SEQUONIA TRAIL  
EAST HAMPTON, CT 06424

CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II

SITE ADDRESS: EAST HAMPTON, CT 06424


APT FILING NUMBER: CT567110

DATE: 02/14/20  
DRAWN BY: CSH  
CHECKED BY: BJP

SHEET TITLE:  
**SEDIMENTATION & EROSION CONTROL PLAN (PHASE 2)**


SHEET NUMBER:

**EC-4**

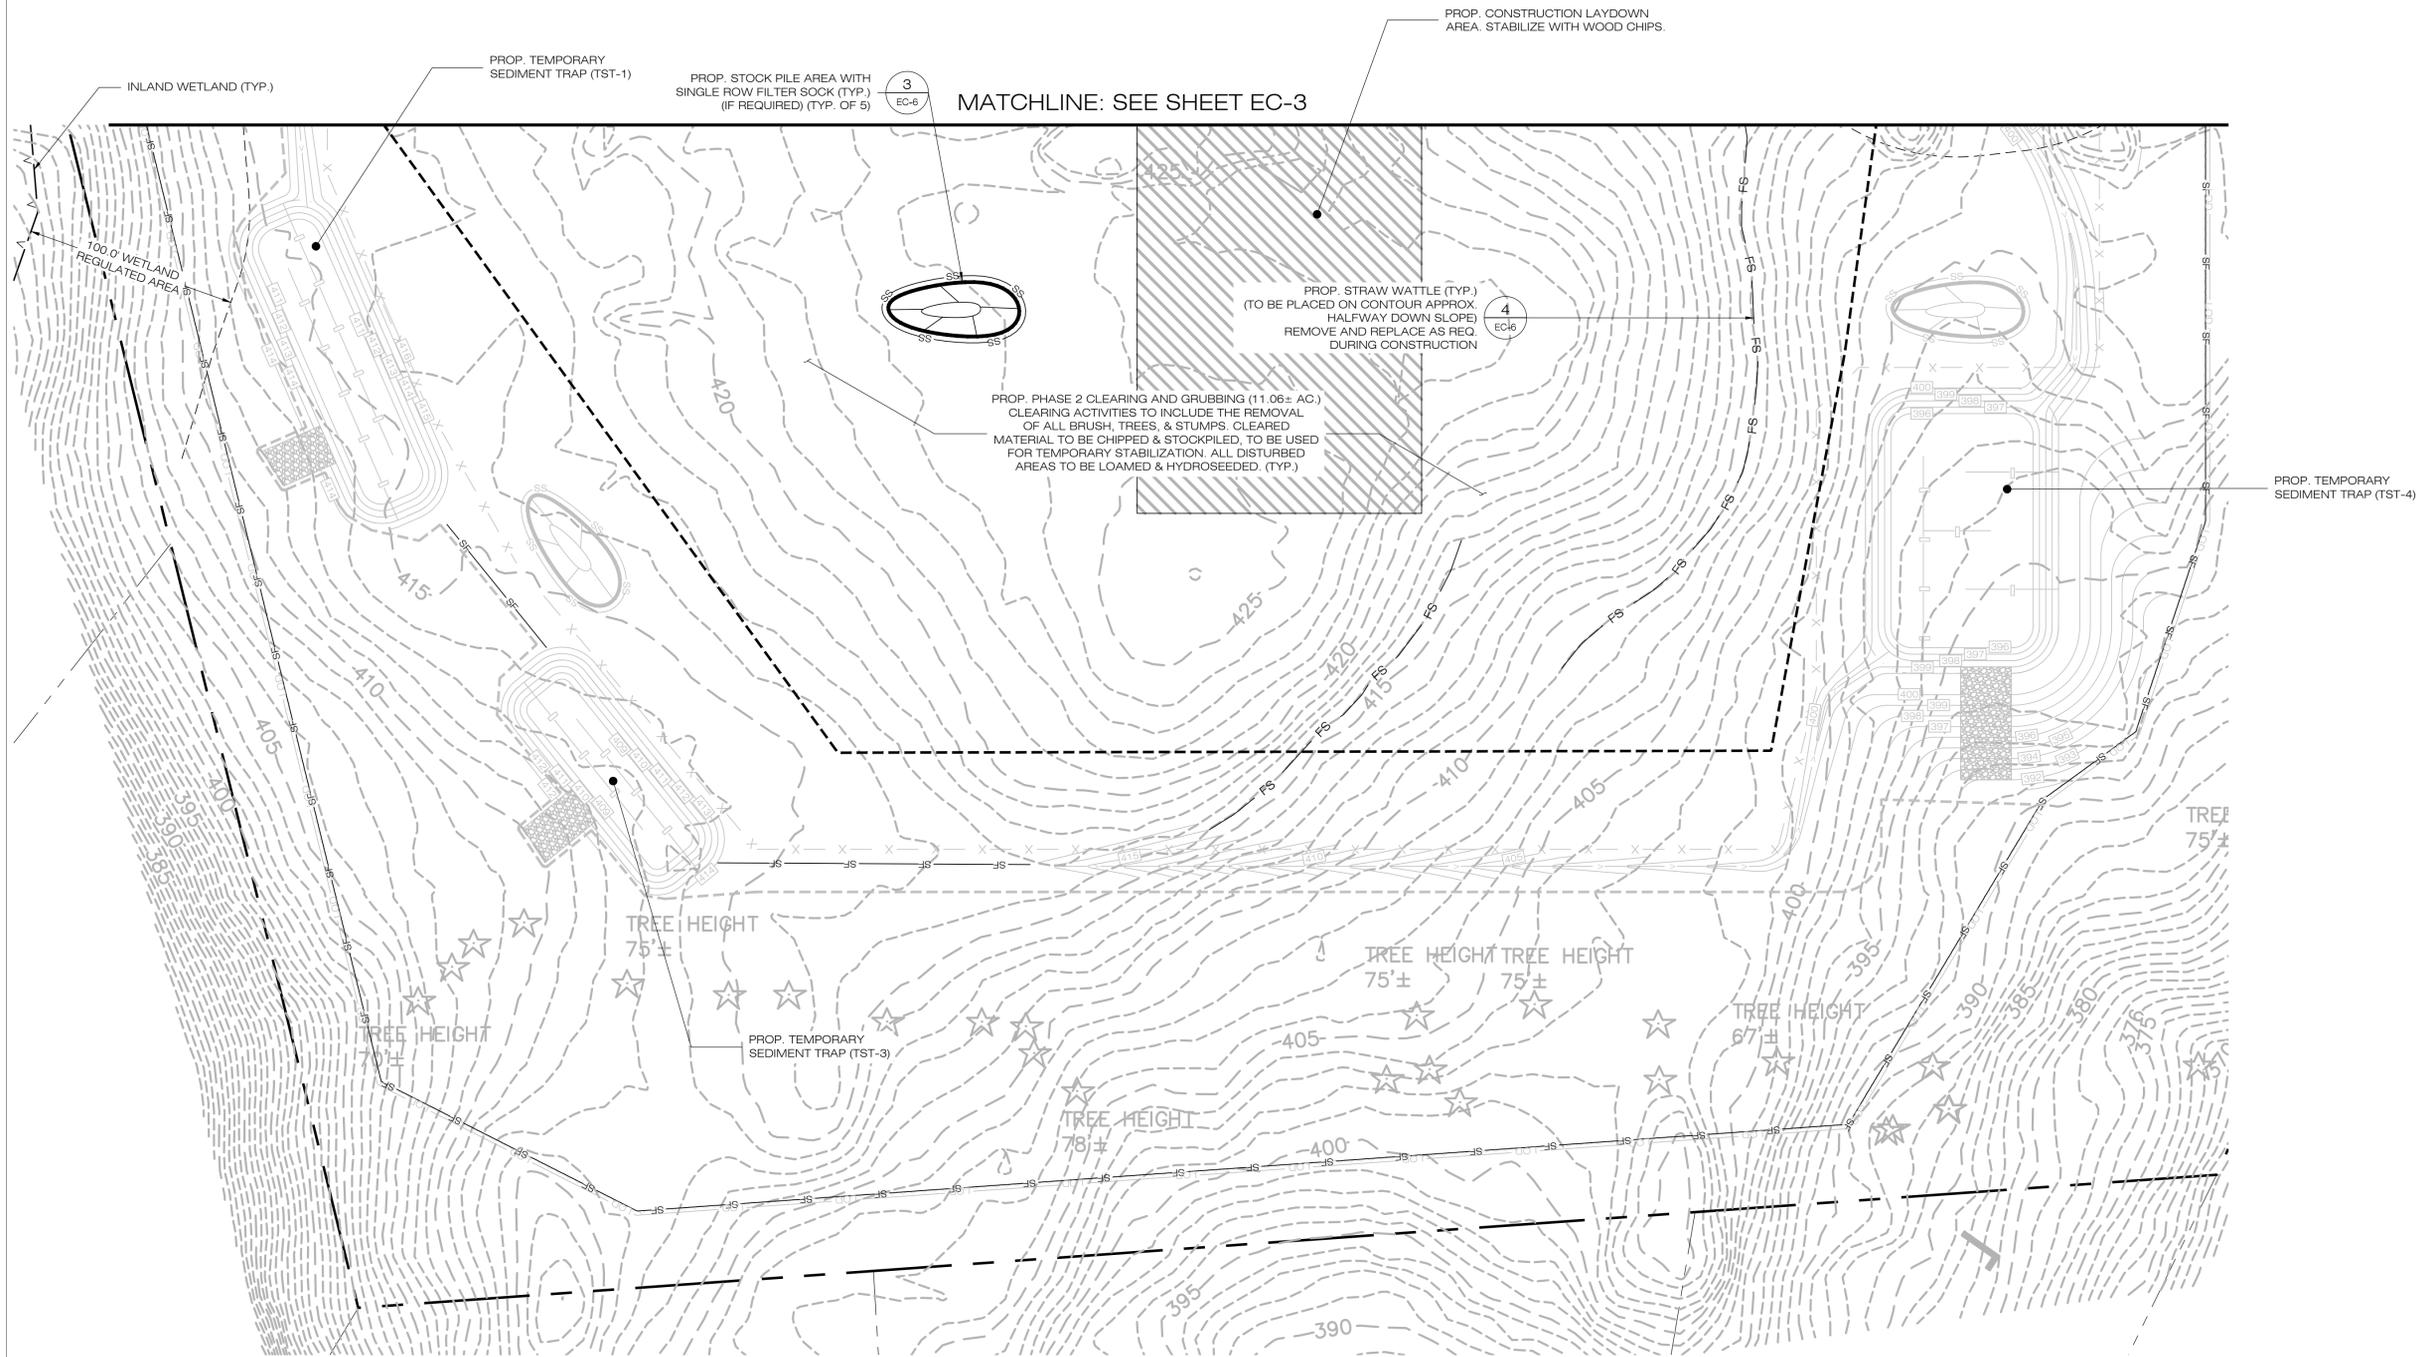

**1 SEDIMENTATION & EROSION CONTROL PLAN**

SCALE: 1" = 40'-0"



# EROSION CONTROL NOTES

## EROSION AND SEDIMENT CONTROL PLAN NOTES

- THE CONTRACTOR SHALL CONSTRUCT ALL SEDIMENT AND EROSION CONTROLS IN ACCORDANCE WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, LATEST EDITION, IN ACCORDANCE WITH THE CONTRACT DOCUMENTS, AND AS DIRECTED BY THE TOWN OF PERMITTEE AND/OR SWPCP MONITOR. ALL PERIMETER SEDIMENTATION AND EROSION CONTROL MEASURES SHALL BE INSTALLED PRIOR TO THE START OF CLEARING AND GRUBBING AND DEMOLITION OPERATIONS.
- THESE DRAWINGS ARE ONLY INTENDED TO DESCRIBE THE SEDIMENT AND EROSION CONTROL MEASURES FOR THIS SITE. ALL TEMPORARY EROSION AND SEDIMENT CONTROL MEASURES SHOWN ON THE EROSION & SEDIMENT CONTROL PLAN ARE SHOWN IN A GENERAL SIZE AND LOCATION ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ENSURING THAT ALL EROSION CONTROL MEASURES ARE CONFIGURED AND CONSTRUCTED IN A MANNER THAT WILL MINIMIZE EROSION OF SOILS AND PREVENT THE TRANSPORT OF SEDIMENTS AND OTHER POLLUTANTS TO STORM DRAINAGE SYSTEMS AND/OR WATERCOURSES. ACTUAL SITE CONDITIONS OR SEASONAL AND CLIMATIC CONDITIONS MAY WARRANT ADDITIONAL CONTROLS OR CONFIGURATIONS, AS REQUIRED, AND AS DIRECTED BY THE PERMITTEE AND/OR SWPCP MONITOR. SEE SEDIMENT AND EROSION CONTROL DETAILS AND SUGGESTED CONSTRUCTION SEQUENCE FOR MORE INFORMATION. REFER TO SITE PLAN FOR GENERAL INFORMATION AND OTHER CONTRACT PLANS FOR APPROPRIATE INFORMATION.
- A BOND OR LETTER OF CREDIT MAY BE REQUIRED TO BE POSTED WITH THE GOVERNING AUTHORITY FOR THE EROSION CONTROL INSTALLATION AND MAINTENANCE.
- THE CONTRACTOR SHALL APPLY THE MINIMUM EROSION & SEDIMENT CONTROL MEASURES SHOWN ON THE PLAN IN CONJUNCTION WITH CONSTRUCTION SEQUENCING, SUCH THAT ALL ACTIVE WORK ZONES ARE PROTECTED. ADDITIONAL AND/OR ALTERNATIVE SEDIMENT AND EROSION CONTROL MEASURES MAY BE INSTALLED DURING THE CONSTRUCTION PERIOD IF FOUND NECESSARY BY THE CONTRACTOR, OWNER, SITE ENGINEER, MUNICIPAL OFFICIALS, OR ANY GOVERNING AGENCY. THE CONTRACTOR SHALL CONTACT THE OWNER AND APPROPRIATE GOVERNING AGENCIES FOR APPROVAL IF ALTERNATIVE CONTROLS OTHER THAN THOSE SHOWN ON THE PLANS ARE PROPOSED BY THE CONTRACTOR.
- THE CONTRACTOR SHALL TAKE EXTREME CARE DURING CONSTRUCTION SO AS NOT TO DISTURB UNPROTECTED WETLAND AREAS OR INSTALLED SEDIMENTATION AND EROSION CONTROL MEASURES. THE CONTRACTOR SHALL INSPECT ALL SEDIMENT AND EROSION CONTROLS WEEKLY AND WITHIN 24 HOURS OF A STORM WITH A RAINFALL AMOUNT OF 0.25 INCHES OR GREATER TO VERIFY THAT THE CONTROLS ARE OPERATING PROPERLY AND MAKE REPAIRS AS NECESSARY IN A TIMELY MANNER.
- THE CONTRACTOR SHALL KEEP A SUPPLY OF EROSION CONTROL MATERIAL (SILT FENCE, COMPOST FILTER SOCK, EROSION CONTROL BLANKET, ETC.) ON-SITE FOR PERIODIC MAINTENANCE AND EMERGENCY REPAIRS.
- ALL FILL MATERIAL PLACED ADJACENT TO ANY WETLAND AREA SHALL BE GOOD QUALITY, WITH LESS THAN 5% FINES PASSING THROUGH A #200 SIEVE (BANK RUN), SHALL BE PLACED IN MAXIMUM ONE FOOT LIFTS, AND SHALL BE COMPACTED TO 95% MAX. DRY DENSITY MODIFIED PROCTOR OR AS SPECIFIED IN THE CONTRACT SPECIFICATIONS.
- PROTECT EXISTING TREES THAT ARE TO BE SAVED BY FENCING, ORANGE SAFETY FENCE, CONSTRUCTION TAPE, OR EQUIVALENT FENCING/TAPE. ANY LIMB TRIMMING SHOULD BE DONE AFTER CONSULTATION WITH AN ARBORIST AND BEFORE CONSTRUCTION BEGINS IN THAT AREA; FENCING SHALL BE MAINTAINED AND REPAIRED DURING CONSTRUCTION.
- CONSTRUCTION ENTRANCES (ANTI-TRACKING PADS) SHALL BE INSTALLED PRIOR TO ANY SITE EXCAVATION OR CONSTRUCTION ACTIVITY AND SHALL BE MAINTAINED THROUGHOUT THE DURATION OF ALL CONSTRUCTION IF REQUIRED. THE LOCATION OF THE TRACKING PADS MAY CHANGE AS VARIOUS PHASES OF CONSTRUCTION ARE COMPLETED. CONTRACTOR SHALL ENSURE THAT ALL VEHICLES EXITING THE SITE ARE PASSING OVER THE ANTI-TRACKING PADS PRIOR TO EXISTING.
- ALL CONSTRUCTION SHALL BE CONTAINED WITHIN THE LIMIT OF DISTURBANCE, WHICH SHALL BE MARKED WITH SILT FENCE, SAFETY FENCE, HAY BALES, RIBBONS, OR OTHER MEANS PRIOR TO CLEARING. CONSTRUCTION ACTIVITY SHALL REMAIN ON THE UPHILL SIDE OF THE SEDIMENT BARRIER UNLESS WORK IS SPECIFICALLY CALLED FOR ON THE DOWNHILL SIDE OF THE BARRIER.
- NO CUT OR FILL SLOPES SHALL EXCEED 2:1 EXCEPT WHERE STABILIZED BY ROCK FACED EMBANKMENTS OR EROSION CONTROL BLANKETS. ALL SLOPES SHALL BE SEED AND BANKS WILL BE STABILIZED IMMEDIATELY UPON COMPLETION OF FINAL GRADING UNTIL TURF IS ESTABLISHED.
- DIRECT ALL DEWATERING PUMP DISCHARGE TO A SEDIMENT CONTROL DEVICE THE GUIDELINES WITHIN THE APPROVED LIMIT OF DISTURBANCE IF REQUIRED. DISCHARGE TO STORM DRAINS OR SURFACE WATERS FROM SEDIMENT CONTROLS SHALL BE CLEAR AND APPROVED BY THE PERMITTEE OR MUNICIPALITY.
- THE CONTRACTOR SHALL MAINTAIN A CLEAN CONSTRUCTION SITE AND SHALL NOT ALLOW THE ACCUMULATION OF RUBBISH OR CONSTRUCTION DEBRIS ON THE SITE. PROPER SANITARY DEVICES SHALL BE MAINTAINED ON-SITE AT ALL TIMES AND SECURED APPROPRIATELY. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO AVOID THE SPILLAGE OF FUEL OR OTHER POLLUTANTS ON THE CONSTRUCTION SITE AND SHALL ADHERE TO ALL APPLICABLE POLICIES AND REGULATIONS RELATED TO SPILL PREVENTION AND RESPONSE/CONTAINMENT.
- MINIMIZE LAND DISTURBANCES. SEED AND MULCH DISTURBED AREAS WITH TEMPORARY MIX AS SOON AS PRACTICABLE (2 WEEK MAXIMUM UNSTABILIZED PERIOD) USING PERENNIAL RYEGRASS AT 40 LBS PER ACRE. MULCH ALL CUT AND FILL SLOPES AND SWALES WITH LOOSE HAY AT A RATE OF 2 TONS PER ACRE. IF NECESSARY, REPLACE LOOSE HAY ON SLOPES WITH EROSION CONTROL BLANKETS OR JUTE CLOTH. MODERATELY GRADED AREAS, ISLANDS, AND TEMPORARY CONSTRUCTION STAGING AREAS MAY BE HYDROSEED WITH TACKIFIER.
- SWEEP AFFECTED PORTIONS OF OFF SITE ROADS ONE OR MORE TIMES A DAY (OR LESS FREQUENTLY IF TRACKING IS NOT A PROBLEM) DURING CONSTRUCTION. FOR DUST CONTROL, PERIODICALLY MOISTEN EXPOSED SOIL SURFACES WITH WATER ON UNPAVED TRAVELWAYS TO KEEP THE TRAVELWAYS DAMP. CALCIUM CHLORIDE MAY ALSO BE APPLIED TO ACCESS ROADS. DUMP TRUCK LOADS EXITING THE SITE SHALL BE COVERED.
- TURF ESTABLISHMENT SHALL BE PERFORMED OVER ALL DISTURBED SOIL, UNLESS THE AREA IS UNDER ACTIVE CONSTRUCTION. IT IS COVERED IN STONE OR SCHEDULED FOR PAVING WITHIN 30 DAYS. TEMPORARY SEEDING OR NON-LIVING SOIL PROTECTION OF ALL EXPOSED SOILS AND SLOPES SHALL BE INITIATED WITHIN THE FIRST 7 DAYS OF SUSPENDING WORK IN AREAS TO BE LEFT LONGER THAN 30 DAYS.
- MAINTAIN ALL PERMANENT AND TEMPORARY SEDIMENT CONTROL DEVICES IN EFFECTIVE CONDITION THROUGHOUT THE CONSTRUCTION PERIOD. UPON COMPLETION OF WORK SWEEP CONCRETE PADS, CLEAN THE STORMWATER MANAGEMENT SYSTEMS AND REMOVE ALL TEMPORARY SEDIMENT CONTROLS ONCE THE SITE IS FULLY STABILIZED AND APPROVAL HAS BEEN RECEIVED FROM PERMITTEE OR THE MUNICIPALITY.
- SEEDING MIXTURES SHALL BE NEW ENGLAND SEMI-SHADE GRASS AND FORBS MIX (SEE SITE DETAILS SHEET DN-1), OR APPROVED EQUAL BY OWNER.

## SEDIMENT & EROSION CONTROL NARRATIVE

- THE PROJECT INVOLVES THE CONSTRUCTION OF A GROUND MOUNTED SOLAR PANEL FACILITY WITH ASSOCIATED EQUIPMENT, INCLUDING THE CLEARING ONLY OF APPROXIMATELY 3.21 ACRES AND THE CLEARING, GRUBBING AND GRADING OF APPROXIMATELY 11.06 ACRES OF EXISTING LOT.
- THE PROPOSED PROJECT INVOLVES THE FOLLOWING CONSTRUCTION:
  - CLEARING, GRUBBING, AND GRADING OF EXISTING LOT.
  - CONSTRUCTION OF 6,994 GROUND MOUNTED SOLAR PANELS AND ASSOCIATED EQUIPMENT.
  - THE STABILIZATION OF DISTURBED AREAS WITH PERMANENT GRASS TREATMENTS.
- FOR THIS PROJECT, THERE ARE APPROXIMATELY 14.93± ACRE OF THE SITE BEING DISTURBED WITH NEGLIGIBLE INCREASE IN THE IMPERVIOUS AREA OF THE SITE, AS ALL ACCESS THROUGH THE SITE WILL BE GRAVEL. IMPERVIOUS AREAS ARE LIMITED TO THE CONCRETE PADS FOR ELECTRICAL EQUIPMENT.
- THE PROJECT SITE, AS MAPPED IN THE SOIL SURVEY OF STATE OF CONNECTICUT (NRCS, VERSION 18, DEC 6, 2018), CONTAINS TYPE 61B AND 71C (HYDROLOGIC SOIL GROUP B), 308 (HYDROLOGIC SOIL GROUP C) AND 71E (HYDROLOGIC SOIL GROUP D) SOILS. A GEOTECHNICAL ENGINEERING REPORT HAS NOT BEEN COMPLETED.
- IT IS ANTICIPATED THAT CONSTRUCTION WILL BE COMPLETED IN APPROXIMATELY 3-4 MONTHS.
- REFER TO THE CONSTRUCTION SEQUENCING AND EROSION AND SEDIMENTATION NOTES FOR INFORMATION REGARDING SEQUENCING OF MAJOR OPERATIONS IN THE ON-SITE CONSTRUCTION PHASES.
- STORMWATER MANAGEMENT DESIGN CRITERIA UTILIZES THE APPLICABLE SECTIONS OF THE 2004 CONNECTICUT STORMWATER QUALITY MANUAL AND THE TOWN OF EAST HAMPTON STANDARDS, TO THE EXTENT POSSIBLE AND PRACTICABLE FOR THIS PROJECT ON THIS SITE. EROSION AND SEDIMENTATION MEASURES ARE BASED UPON ENGINEERING PRACTICE, JUDGEMENT AND THE APPLICABLE SECTIONS OF THE CONNECTICUT EROSION AND SEDIMENT CONTROL GUIDELINES FOR URBAN AND SUBURBAN AREAS, LATEST EDITION.
- DETAILS FOR THE TYPICAL STORMWATER MANAGEMENT AND EROSION AND SEDIMENTATION MEASURES ARE SHOWN ON THE PLAN SHEETS OR PROVIDED AS SEPARATE SUPPORT DOCUMENTATION FOR REVIEW IN THIS PLAN.
- CONSERVATION PRACTICES TO BE USED DURING CONSTRUCTION AREA:
  - STAGED CONSTRUCTION;
  - MINIMIZE THE DISTURBED AREAS TO THE EXTENT PRACTICABLE DURING CONSTRUCTION;
  - STABILIZE DISTURBED AREAS AS SOON AS POSSIBLE WITH TEMPORARY OR PERMANENT MEASURES;
  - MINIMIZE IMPERVIOUS AREAS;
  - UTILIZE APPROPRIATE CONSTRUCTION EROSION AND SEDIMENTATION MEASURES.
- THE FOLLOWING SEPARATE DOCUMENTS ARE TO BE CONSIDERED A PART OF THE EROSION AND SEDIMENTATION PLAN:
  - STORMWATER MANAGEMENT MEMO FOR EXISTING AND PROPOSED PEAK FLOWS.

## CONSTRUCTION SEQUENCE

THE FOLLOWING SEQUENCE OF CONSTRUCTION ACTIVITIES IS PROJECTED BASED UPON ENGINEERING JUDGEMENT AND BEST MANAGEMENT PRACTICES. THE CONTRACTOR SHALL NOT ALTER THE CONSTRUCTION SEQUENCE WITHOUT PRIOR WRITTEN APPROVAL FROM THE ENGINEER AND CT DEEP. ANY PROPOSED CHANGES TO THE CONSTRUCTION SEQUENCE SHALL BE SUBMITTED TO THE ENGINEER IN WRITING FOR REVIEW PRIOR TO THE START OF CONSTRUCTION.

### PRE-CONSTRUCTION

- CONTACT THE APPLICANT, ENGINEER, CT DEEP, AND REPRESENTATIVES TO SCHEDULE A PRE-CONSTRUCTION MEETING AT LEAST 5 DAYS PRIOR TO THE START OF CONSTRUCTION. PHYSICALLY FLAG THE LIMITS OF CLEARING IN THE FIELD AS NECESSARY TO FACILITATE THE PRE-CONSTRUCTION MEETING.
- CONDUCT A PRE-CONSTRUCTION MEETING TO DISCUSS THE PROP. WORK AND EROSION AND SEDIMENTATION CONTROL MEASURES. THE MEETING SHOULD BE ATTENDED BY THE APPLICANT, THE APPLICANT REPRESENTATIVE(S), CT DEEP, THE GENERAL CONTRACTOR, DESIGNATED SUB-CONTRACTORS AND THE PERSON, OR PERSONS, RESPONSIBLE FOR THE IMPLEMENTATION, OPERATION, MONITORING AND MAINTENANCE OF THE EROSION AND SEDIMENTATION MEASURES. THE CONSTRUCTION PROCEDURES FOR THE ENTIRE PROJECT SHALL BE REVIEWED AT THIS MEETING.
- NOTIFY THE APPLICANT AT LEAST FORTY-EIGHT (48) HOURS PRIOR TO COMMENCEMENT OF ANY DEMOLITION, CONSTRUCTION OR REGULATED ACTIVITY ON THIS PROJECT. NOTIFY CALL BEFORE YOU DIG AT 1-800-922-4455.

### PHASE 1

- PERFORM CLEARING OF TREES ON SITE WITH NO GRUBBING, STUMPS TO REMAIN. CLEARING WORK SHALL BE ALLOWED DURING THE WINTER MONTHS ONLY IF THE GROUND IS FROZEN.
- CLEAR AND GRUB AS REQUIRED AND SHOWN ON EC-1 AND EC-2 TO INSTALL THE PERIMETER EROSION SEDIMENTATION CONTROL MEASURES AND CONSTRUCTION ENTRANCE.
- INSTALL PERIMETER SILT SOCK.
- ALL WETLAND AREAS SHALL BE PROTECTED PRIOR TO THE START OF MAJOR CONSTRUCTION.
- INSTALL GRAVEL AND COMPACTED EARTH ACCESS ROADS.
- INSTALL SWALES, TST-1, TST-2A, TST-2B, TST-3, AND TST-4.
- STOCKPILE TOPSOIL FOR REUSE.
- STABILIZE DISTURBED AREAS WITH LOAM AND HYDROSEED WITH TACKIFIER.
- INSTALL TREE PROTECTION IF APPLICABLE.
- NOTIFY CONNECTICUT RIVER COASTAL CONSERVATION DISTRICT AND QUALIFIED PROFESSIONAL OF COMPLETION PHASE FOR REQUIRED SITE INSPECTIONS IN ACCORDANCE WITH THE GENERAL PERMIT.

### PHASE 2 (UPON INSTALLATION OF TEMPORARY SEDIMENT TRAPS)

- PERFORM REMAINING GRUBBING AS NECESSARY. REMOVE CUT WOOD AND STOCKPILE FOR FUTURE USE OR REMOVE OFF-SITE. REMOVE AND DISPOSE OF DEMOLITION DEBRIS OFF-SITE IN ACCORDANCE WITH APPLICABLE LAWS.
- STOCKPILE TOPSOIL.
- PERFORM ANY GRADING NECESSARY FOR THE SHAPING OF THE SITE EAST OF THE COMPACTED EARTH ACCESS ROAD.
- LOAM AND HYDROSEED (WITH TEMPORARY SEED MIX) WITH TACKIFIER REMAINING DISTURBED AREAS.
- NOTIFY CONNECTICUT RIVER COASTAL CONSERVATION DISTRICT AND QUALIFIED PROFESSIONAL OF COMPLETION PHASE FOR REQUIRED SITE INSPECTIONS IN ACCORDANCE WITH THE GENERAL PERMIT.

### PHASE 3 (UPON GROUND COVER BEING ESTABLISHED)

- INSTALL ELECTRICAL CONDUIT AND CONCRETE PADS.
- INSTALL RACKING POSTS FOR GROUND MOUNTED SOLAR PANELS
- INSTALL GROUND MOUNTED SOLAR PANELS AND COMPLETE ELECTRICAL INSTALLATION.
- INSTALL PERIMETER CHAIN LINK FENCE AS SHOWN ON THE PLANS.
- NOTIFY CONNECTICUT RIVER COASTAL CONSERVATION DISTRICT AND QUALIFIED PROFESSIONAL OF COMPLETION PHASE FOR REQUIRED SITE INSPECTIONS IN ACCORDANCE WITH THE GENERAL PERMIT.

### PHASE 4

- HYDROSEED WITH TACKIFIER ALL REMAINING DISTURBED AREAS.
- HYDROSEED WITH TACKIFIER THE POLLINATOR HABITAT.
- AFTER SUBSTANTIAL COMPLETION OF THE INSTALLATION OF THE SOLAR FACILITY AND THE AREAS ABOVE TST'S ARE DEEMED STABILIZED BY THE QUALIFIED INSPECTOR, COMPLETE REMAINING SITE WORK, INCLUDING CLEANING INFILTRATION BASINS, REMOVING BAFFLES, AND REBUILDING OVERFLOW WEIRS WITH IMPERVIOUS CORE.
- INSTALL/REBUILD GRAVEL ACCESS DRIVES.
- FINE GRADE, RAKE, SEED, AND MULCH ALL REMAINING DISTURBED AREAS.
- NOTIFY CONNECTICUT RIVER COASTAL CONSERVATION DISTRICT AND QUALIFIED PROFESSIONAL OF COMPLETION PHASE FOR REQUIRED SITE INSPECTIONS IN ACCORDANCE WITH THE GENERAL PERMIT.
- AFTER THE SITE IS STABILIZED AND WITH THE APPROVAL OF THE PERMITTEE AND QUALIFIED INSPECTOR, REMOVE PERIMETER EROSION AND SEDIMENTATION CONTROLS.
- ISSUE NOTICE OF TERMINATION AND PERFORM PROJECT CLEANUP.

CONSTRUCTION OPERATION AND MAINTENANCE PLAN - BY CONTRACTOR		
E&S MEASURE	INSPECTION SCHEDULE	MAINTENANCE REQUIRED
CONSTRUCTION ENTRANCE	DAILY	PLACE ADDITIONAL STONE, EXTEND THE LENGTH OR REMOVE AND REPLACE THE STONE. CLEAN PAVED SURFACES OF TRACKED SEDIMENT.
COMPOST FILTER SOCK	WEEKLY & WITHIN 24 HOURS OF RAINFALL > 0.25"	REPAIR/REPLACE WHEN FAILURE OR DETERIORATION IS OBSERVED.
SILT FENCE	WEEKLY & WITHIN 24 HOURS OF RAINFALL > 0.25"	REPAIR/REPLACE WHEN FAILURE OR DETERIORATION IS OBSERVED. REMOVE SILT WHEN IT REACHES 1/2 THE HEIGHT OF THE FENCE.
TOPSOIL/BORROW STOCKPILES	DAILY	REPAIR/REPLACE SEDIMENT BARRIERS AS NECESSARY.
TEMPORARY SEDIMENT BASIN (W/ BAFFLES)	WEEKLY & WITHIN 24 HOURS OF RAINFALL > 0.5"	REMOVE SEDIMENT ONCE IT HAS ACCUMULATED TO ONE HALF OF MINIMUM REQUIRED VOLUME OF THE WET STORAGE. DEWATERING AS NEEDED. RESTORE TRAP TO ORIGINAL DIMENSIONS. REPAIR/REPLACE BAFFLES WHEN FAILURE OR DETERIORATION IS OBSERVED.
TEMPORARY SEDIMENT TRAP (W/ BAFFLES)	WEEKLY & WITHIN 24 HOURS OF RAINFALL > 0.5"	REMOVE SEDIMENT ONCE IT HAS ACCUMULATED TO ONE HALF OF MINIMUM REQUIRED VOLUME OF THE WET STORAGE. DEWATERING AS NEEDED. RESTORE TRAP TO ORIGINAL DIMENSIONS. REPAIR/REPLACE BAFFLES WHEN FAILURE OR DETERIORATION IS OBSERVED.
TEMPORARY SOIL PROTECTION	WEEKLY & WITHIN 24 HOURS OF RAINFALL > 0.25"	REPAIR ERODED OR BARE AREAS IMMEDIATELY. RESEED AND MULCH.



**55 GREENS FARMS ROAD  
WESTPORT, CT 06880  
OFFICE: (203)-557-5554**



3 SADDLEBROOK DRIVE PHONE: (860)-663-1697  
KILLINGWORTH, CT 06419 FAX: (860)-663-0935  
WWW.ALLPOINTSTECH.COM

## CSC PERMIT SET

NO	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

## DESIGN PROFESSIONAL OF RECORD

**PROF. BRADLEY J. PARSONS P.E.  
COMP: ALL-POINTS TECHNOLOGY CORPORATION  
ADD: 3 SADDLEBROOK DRIVE  
KILLINGWORTH, CT 06419**

**OWNER: SKINNER STREET PROPERTIES LLC  
ADDRESS: 9 SEQUONIA TRAIL  
EAST HAMPTON, CT 06424**

## CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II

**SITE 46 SKINNER STREET  
ADDRESS: EAST HAMPTON, CT 06424**


**APT FILING NUMBER: CT567110**


	<b>DRAWN BY: CSH</b>
<b>DATE: 02/14/20</b>	<b>CHECKED BY: BJP</b>

**SHEET TITLE:  
SEDIMENTATION & EROSION CONTROL NOTES**

**SHEET NUMBER:**


**EC-5**



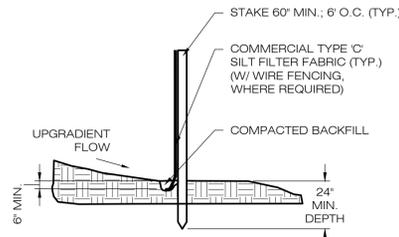


NOTE:  
SILT FENCE SHALL BE LAPPED ONLY  
WHEN NECESSARY PER THE  
MANUFACTURER RECOMMENDATIONS.

**1 SILT FENCE DETAIL**  
EC-6 SCALE: N.T.S.

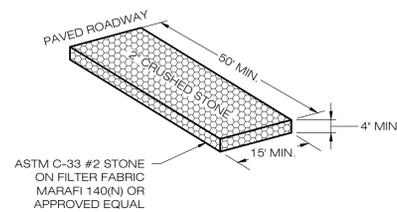

**2 CONSTRUCTION ENTRANCE DETAIL**  
EC-6 SCALE: N.T.S.

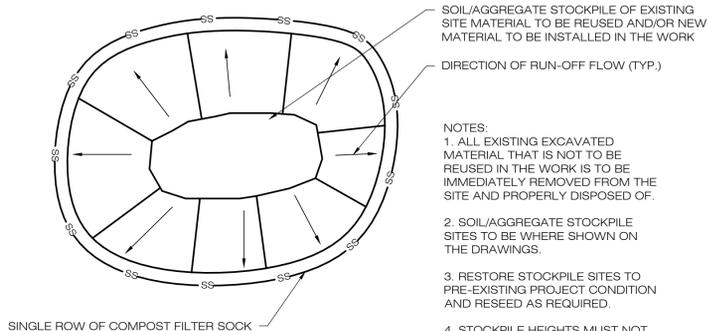


SOIL/AGGREGATE STOCKPILE OF EXISTING  
SITE MATERIAL TO BE REUSED AND/OR NEW  
MATERIAL TO BE INSTALLED IN THE WORK

DIRECTION OF RUN-OFF FLOW (TYP.)

NOTES:  
1. ALL EXISTING EXCAVATED  
MATERIAL THAT IS NOT TO BE  
REUSED IN THE WORK IS TO BE  
IMMEDIATELY REMOVED FROM THE  
SITE AND PROPERLY DISPOSED OF.  
2. SOIL/AGGREGATE STOCKPILE  
SITES TO BE WHERE SHOWN ON  
THE DRAWINGS.  
3. RESTORE STOCKPILE SITES TO  
PRE-EXISTING PROJECT CONDITION  
AND RESEED AS REQUIRED.  
4. STOCKPILE HEIGHTS MUST NOT  
EXCEED 35'. STOCKPILE SLOPES  
MUST BE 2:1 OR FLATTER.

**3 MATERIALS STOCKPILE DETAIL**  
EC-6 SCALE: N.T.S.

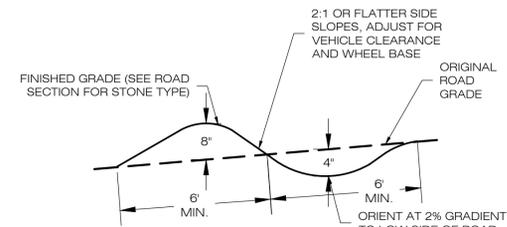

FINISHED GRADE (SEE ROAD  
SECTION FOR STONE TYPE)

2:1 OR FLATTER SIDE  
SLOPES, ADJUST FOR  
VEHICLE CLEARANCE  
AND WHEEL BASE

ORIGINAL  
ROAD  
GRADE

8"  
6"  
6"  
ORIENT AT 2% GRADIENT  
TO LOW SIDE OF ROAD



PROFILE VIEW

NOTES:  
1. SHALL BE ORIENTATED AT A 10 DEGREE ANGLE  
DOWNGRADE.  
2. RIP-RAP OUTFALL SHALL BE INSTALLED AT OUTFALL TO  
AVOID WASHOUT.  
3. WATER BARS SHALL MAINTAIN A MINIMUM OF 6" STONE IN  
ALL AREAS.  
4. MAINTENANCE OF WATERBARS SHALL BE PROVIDED  
UNTIL ROADWAY, SKIDTRAIL, OR DITCH HAS ACHIEVED  
PERMANENT STABILIZATION.  
5. WATERBARS SHALL BE INSTALLED PRIOR TO ANY SWITCH  
BACK OR SHARP CURVE.  
6. WATERBARS SHALL BE GRADED TO PREVENT DAMAGE  
DURING CONSTRUCTION



RECOMMENDED WATER BAR SPACING	
PERCENT SLOPE	SPACING (FT)
1%	400*
5%	125
10%	78
15%	58

\* OR AS DIRECTED BY THE  
ENGINEER OF RECORD.

**6 BROAD BASED DIP DETAIL**  
EC-6 SCALE: N.T.S.

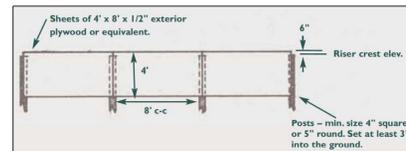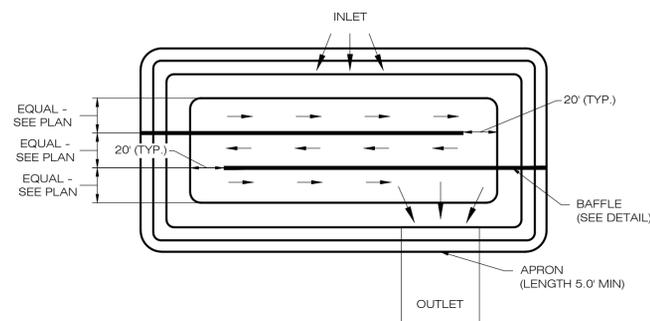


**5 SEDIMENT TRAP BAFFLE**  
EC-6 SCALE: N.T.S.

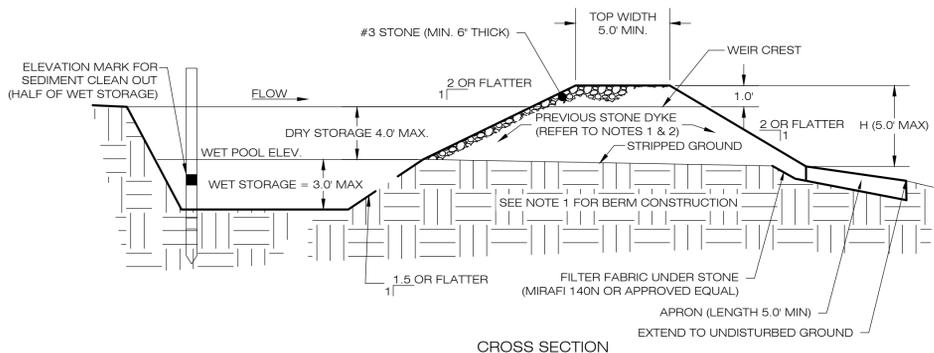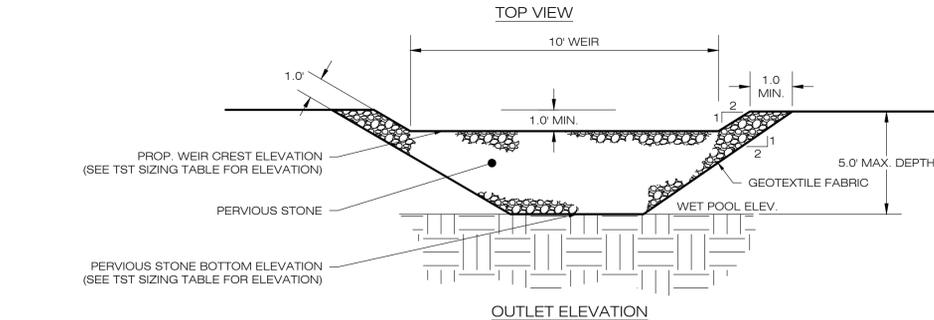

NOTES:  
1. CONSTRUCT TEMPORARY SEDIMENT TRAP BERMS AND SIDEWALLS PER THE INFILTRATION BASIN DETAIL.  
2. PERVIOUS STONE DIKE SHALL BE CONSTRUCTED OF CT DOT MODIFIED RIP-RAP WITH #3 STONE ON FACE.  
3. SEDIMENT TRAP BAFFLES SHALL BE INSTALLED AS SHOWN ON EC-1 AND EC-2.  
4. SEE TST SIZING TABLE FOR WET AND DRY STORAGE VOLUMES.

**4 TEMPORARY SEDIMENT TRAP**  
EC-6 SCALE: N.T.S.

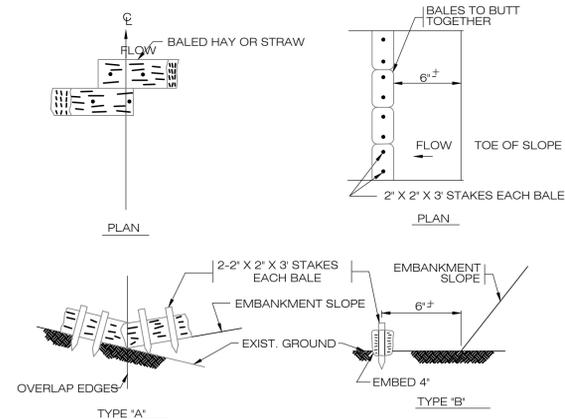

NOTE:  
TO BE USED IN LOCATIONS WHERE  
THE EXISTING GROUND SLOPES IN  
TOWARD THE TOE OF THE EMBANKMENT.

NOTE:  
TO BE USED WHERE THE EXISTING  
GROUND SLOPES AWAY FROM THE TOE  
OF THE EMBANKMENT

**HAYBALE CHECK DAM  
SEDIMENTATION CONTROL BARRIER**  
EC-6 SCALE: N.T.S.

TEMPORARY SEDIMENT TRAP SIZING TABLE										
NAME	DRAINAGE AREA (AC)	SEDIMENT VOLUME/ACRE AREA (CY)	REQ. VOLUME (CY)	REQ. WET VOLUME (CY)	PROP. BTM. ELEV. (FT)	PROP. STONE DIKE BTM. ELEV. (FT)	PROP. WEIR CREST ELEV. (FT)	PROP. TOP ELEV. (FT)	WET VOL. PROVIDED (CY)	TOTAL VOL. PROVIDED (CY)
TST-1	2.83 AC	134 CYD	379.87 CY	189.93 CYD	411.0	412.5	413.5	414.0	270.32 CY	498.88 CY
TST-2A	1.26 AC	134 CYD	168.49 CY	84.25 CYD	417.0	418.5	419.5	420.0	103.86 CY	203.68 CY
TST-2B	0.67 AC	134 CYD	89.45 CY	44.73 CYD	412.0	413.0	414.5	415.0	58.93 CY	186.17 CY
TST-3	1.62 AC	134 CYD	216.75 CY	108.38 CYD	409.0	410.5	411.5	412.5	169.30 CY	319.19 CY
TST-4	4.32 AC	134 CYD	578.66 CY	289.33 CYD	396.0	397.0	399.5	400.5	289.39 CY	1190.41 CY

**CITRINE**  
55 GREENS FARMS ROAD  
WESTPORT, CT 06880  
OFFICE: (203)-557-5554

**ALL-POINTS  
TECHNOLOGY CORPORATION**  
3 SADDLEBROOK DRIVE PHONE: (860)-663-1697  
KILLINGWORTH, CT 06419 FAX: (860)-663-0935  
WWW.ALLPOINTSTECH.COM

CSC PERMIT SET		
NO	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

**DESIGN PROFESSIONAL OF RECORD**  
PROF: BRADLEY J. PARSONS P.E.  
COMP: ALL-POINTS TECHNOLOGY CORPORATION  
ADD: 3 SADDLEBROOK DRIVE  
KILLINGWORTH, CT 06419  
OWNER: SKINNER STREET PROPERTIES LLC  
ADDRESS: 9 SEQUOIA TRAIL  
EAST HAMPTON, CT 06424

**CP EAST HAMPTON SOLAR I &  
CP EAST HAMPTON SOLAR II**  
SITE ADDRESS: EAST HAMPTON, CT 06424  
APT FILING NUMBER: CT567110  
DRAWN BY: CSH  
DATE: 02/14/20 CHECKED BY: BJP

SHEET TITLE:  
**SEDIMENTATION &  
EROSION CONTROL  
DETAILS**

SHEET NUMBER:  
**EC-6**

**CSC PERMIT SET**

NO	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

**DESIGN PROFESSIONAL OF RECORD**

PROF: BRADLEY J. PARSONS P.E.  
COMP: ALL-POINTS TECHNOLOGY CORPORATION  
ADD: 3 SADDLEBROOK DRIVE  
KILLINGWORTH, CT 06419

OWNER: SKINNER STREET PROPERTIES LLC  
ADDRESS: 9 SEQUONIA TRAIL  
EAST HAMPTON, CT 06424

**CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II**

SITE ADDRESS: EAST HAMPTON, CT 06424

APT FILING NUMBER: CT567110

DRAWN BY: CSH


DATE: 02/14/20 CHECKED BY: BJP

**SHEET TITLE:**


**SITE DETAILS**

**SHEET NUMBER:**

**DN-1**

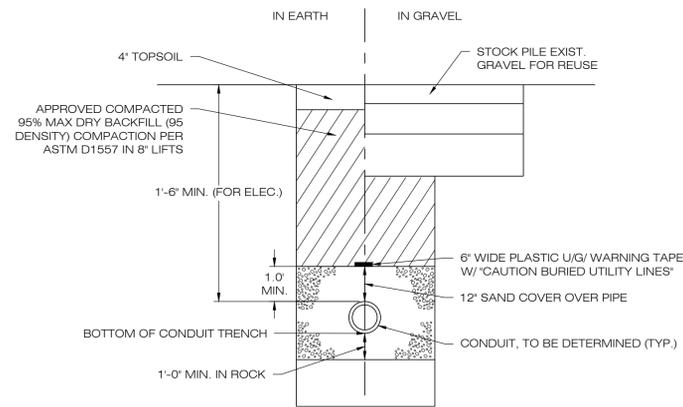


**1 ELECTRICAL TRENCH DETAIL**  
SCALE : N.T.S.

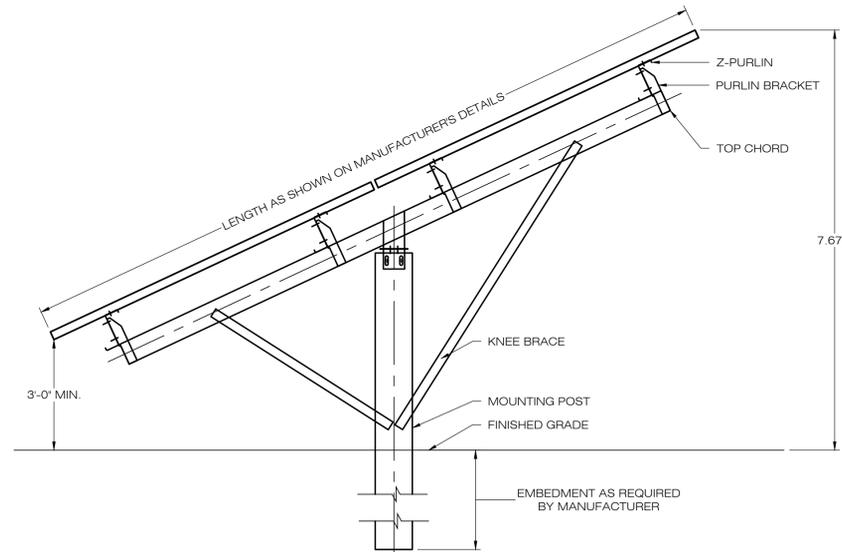


NOTES:  
SEE MANUFACTURERS DETAIL SHEETS FOR ADDITIONAL INFORMATION REGARDING RACKING SYSTEM REQUIREMENTS AND INSTALLATION PROCEDURES. RACKING SYSTEM TO BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS REQUIREMENTS.

**2 TYPICAL POST MOUNTED RACKING SYSTEM**  
SCALE : N.T.S.

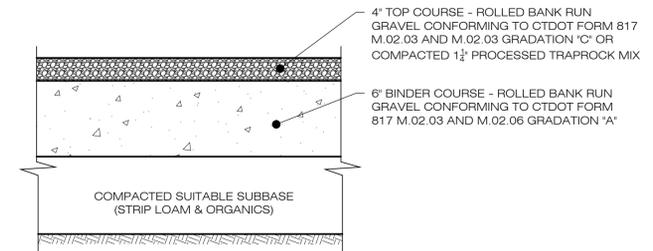


NOTES:  
1. SUBBASE MAY CONSIST OF NATIVE MATERIALS IF FOUND ACCEPTABLE BY THE ENGINEER. SUBBASE TO BE COMPACTED TO 95% MAX DRY DENSITY.  
2. SUBBASE IS TO BE FREE FROM DEBRIS AND UNSUITABLE MATERIALS.


**3 GRAVEL ACCESS DRIVE SECTION**  
SCALE : N.T.S.

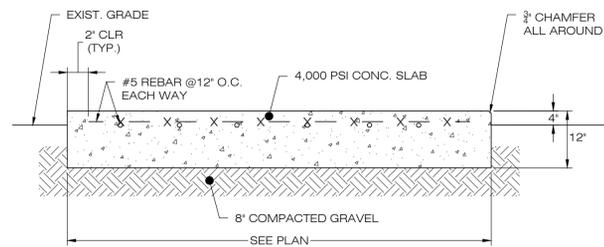

**4 CONCRETE EQUIPMENT PAD**  
SCALE : N.T.S.

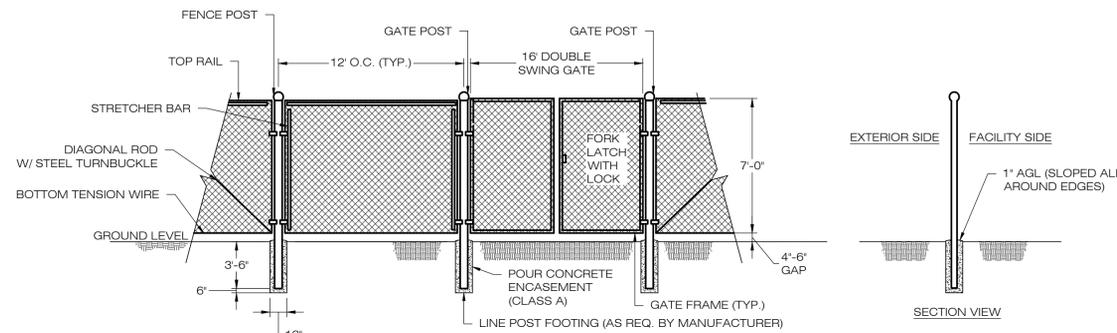


**5 CHAIN-LINK FENCE & GATE DETAIL**  
SCALE : N.T.S.



NOTES:  
EMERGENCY CALL NUMBER TO BE PROVIDED ONCE DETERMINED.


**6 NOTIFICATION SIGN DETAIL**  
SCALE : N.T.S.

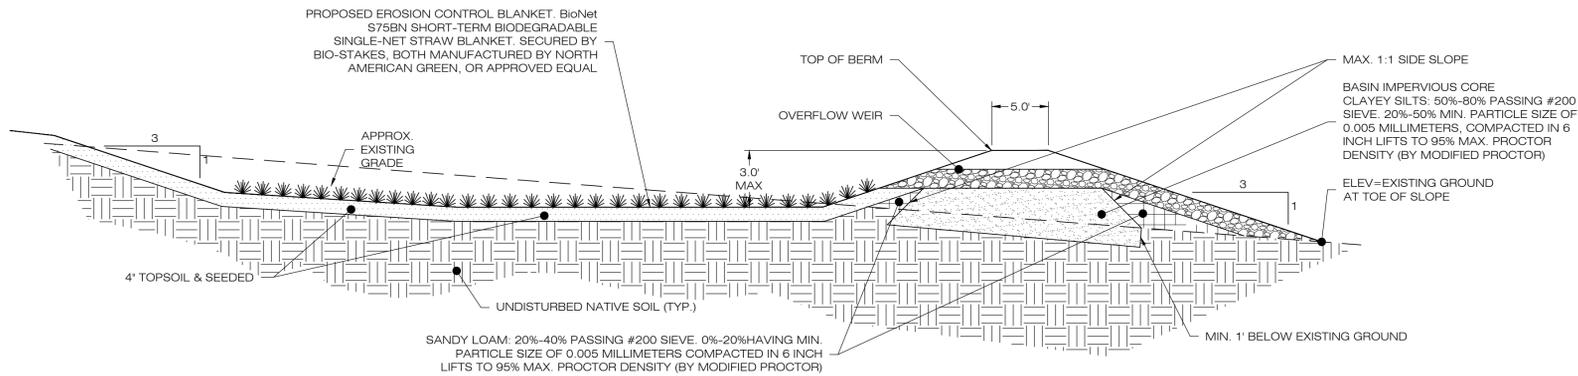


**NOTES:**

- SEED MIX TO BE NEW ENGLAND EROSION CONTROL/RESTORATION MIX FOR MOIST SITES ON THE BOTTOM OF THE BASIN AND NEW ENGLAND EROSION/RESTORATION MIX FOR DRY SITES ON THE SIDE SLOPES.
- FOR CONVERTING TST TO INFILTRATION BASIN, REMOVE BAFFLES, CLEAN OUT SEDIMENT, RESHAPE AS REQUIRED, RECONSTRUCT OUTLET WEIR INCLUDING ADDITIONAL IMPERVIOUS CORE, AND RESEEDING.
- INSPECT AND CLEAN PIPES PRIOR TO INSTALLING PERMANENT OUTLET.

**1 GRASS LINED INFILTRATION BASIN**  
SCALE : N.T.S.

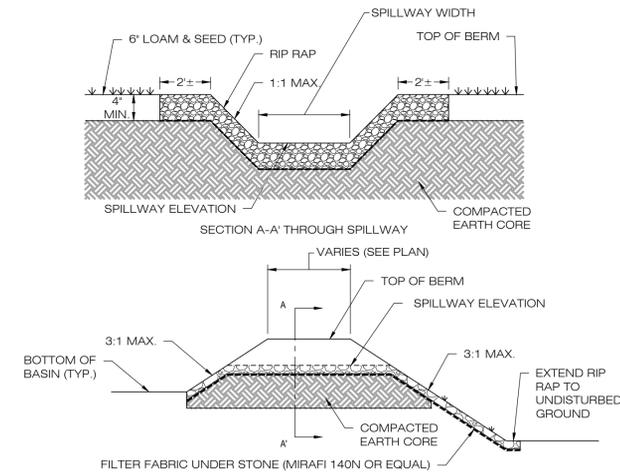


**2 OVERFLOW WEIR DETAIL**  
SCALE : N.T.S.

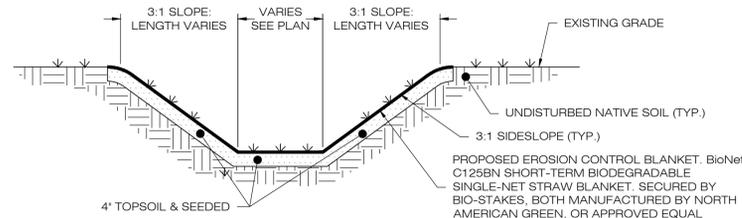

**NOTES:**

- SEED MIX TO BE NEW ENGLAND EROSION CONTROL/RESTORATION MIX FOR MOIST SITES ON THE BOTTOM OF THE BASIN AND NEW ENGLAND EROSION/RESTORATION MIX FOR DRY SITES ON THE SIDE SLOPES.

**3 GRASS LINED SWALE**  
SCALE : N.T.S.

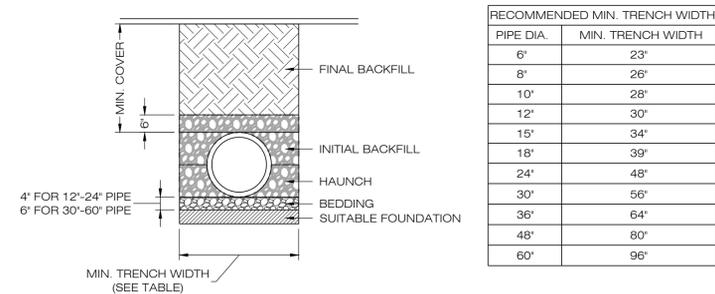

PIPE DIA.	MIN. TRENCH WIDTH
6"	23"
8"	26"
10"	28"
12"	30"
15"	34"
18"	39"
24"	48"
30"	56"
36"	64"
48"	80"
60"	96"

**NOTES:**

- ALL PIPE SYSTEMS SHALL BE INSTALLED IN ACCORDANCE WITH ASTM D2321, "STANDARD PRACTICE FOR UNDERGROUND INSTALLATION OF THERMOPLASTIC PIPE FOR SEWERS AND OTHER GRAVITY FLOW APPLICATIONS", LATEST EDITION.
- MEASURES SHOULD BE TAKEN TO PREVENT MIGRATION OF NATIVE FINES INTO BACKFILL MATERIAL, WHEN REQUIRED.
- FOUNDATION: WHERE THE TRENCH BOTTOM IS UNSTABLE, THE CONTRACTOR SHALL EXCAVATE TO A DEPTH REQUIRED BY THE ENGINEER AND REPLACE WITH SUITABLE MATERIAL AS SPECIFIED BY THE ENGINEER. AS AN ALTERNATIVE AND AT THE DISCRETION OF THE DESIGN ENGINEER, THE TRENCH BOTTOM MAY BE STABILIZED USING A GEOTEXTILE MATERIAL.
- BEDDING: SUITABLE MATERIAL SHALL BE CLASS I, II OR III. THE CONTRACTOR SHALL PROVIDE DOCUMENTATION FOR MATERIAL SPECIFICATION TO ENGINEER, UNLESS OTHERWISE NOTED BY THE ENGINEER. MINIMUM BEDDING THICKNESS SHALL BE 4" (100mm) FOR 4"-24" (100mm-600mm); 6" (150mm) FOR 30"-60" (750mm-900mm).
- INITIAL BACKFILL: SUITABLE MATERIAL SHALL BE CLASS I, II OR III IN THE PIPE ZONE EXTENDING NOT LESS THAN 6" ABOVE CROWN OF PIPE. THE CONTRACTOR SHALL PROVIDE DOCUMENTATION FOR MATERIAL SPECIFICATION TO ENGINEER. MATERIAL SHALL BE INSTALLED AS REQUIRED IN ASTM D2321, LATEST EDITION.
- MINIMUM COVER: MINIMUM COVER, H, IN NON-TRAFFIC APPLICATIONS (GRASS OR LANDSCAPE AREAS) IS 12" FROM THE TOP OF PIPE TO GROUND SURFACE. ADDITIONAL COVER MAY BE REQUIRED TO PREVENT FLOATATION. FOR TRAFFIC APPLICATIONS, MINIMUM COVER, H, IS 12" UP TO 48" DIAMETER PIPE AND 24" OF COVER FOR 54"-60" DIAMETER PIPE, MEASURED FROM TOP OF PIPE TO BOTTOM OF FLEXIBLE PAVEMENT OR TO TOP OF RIGID PAVEMENT.

**4 HDPE STORM DRAINAGE TRENCH DETAIL**  
SCALE : N.T.S.

**CSC PERMIT SET**

NO.	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

**DESIGN PROFESSIONAL OF RECORD**

PROF: BRADLEY J. PARSONS P.E.  
COMP: ALL-POINTS TECHNOLOGY CORPORATION  
ADD: 3 SADDLEBROOK DRIVE  
KILLINGWORTH, CT 06419

OWNER: SKINNER STREET PROPERTIES LLC  
ADDRESS: 9 SEQUONIA TRAIL  
EAST HAMPTON, CT 06424

**CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II**

SITE ADDRESS: 46 SKINNER STREET  
EAST HAMPTON, CT 06424

APT FILING NUMBER: CT567110

DATE: 02/14/20  
DRAWN BY: CSH  
CHECKED BY: BJP

**SHEET TITLE:**  
SITE DETAILS

SHEET NUMBER:  
**DN-2**

## GENERAL NOTES

- ALL CONSTRUCTION SHALL COMPLY WITH PROJECT DEVELOPER STANDARDS, TOWN OF EAST HAMPTON STANDARDS, CONNECTICUT DEPARTMENT OF TRANSPORTATION STANDARDS AND SPECIFICATIONS IN THE ABOVE REFERENCED INCREASING HIERARCHY. IF SPECIFICATIONS ARE IN CONFLICT, THE MORE STRINGENT SPECIFICATION SHALL APPLY.
- IF NO PROJECT CONSTRUCTION SPECIFICATION PACKAGE IS PROVIDED BY THE PROJECT DEVELOPER OR THEIR REPRESENTATIVE, THE CONTRACTOR SHALL COMPLY WITH THE MANUFACTURE, TOWN OF EAST HAMPTON, OR CONNECTICUT DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS, AND BE IN ACCORDANCE WITH ALL APPLICABLE OSHA, FEDERAL, STATE AND LOCAL REGULATIONS.
- THE PROJECT DEVELOPER IS RESPONSIBLE FOR OBTAINING ALL NECESSARY ZONING AND STORMWATER PERMITS REQUIRED BY GOVERNMENT AGENCIES PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL OBTAIN ALL TOWN OF EAST HAMPTON CONSTRUCTION PERMITS. THE CONTRACTOR SHALL POST ALL BONDS, PAY ALL FEES, PROVIDE PROOF OF INSURANCE AND PROVIDE TRAFFIC CONTROL NECESSARY FOR THIS WORK.
- REFER TO PLANS, DETAILS AND REPORTS PREPARED BY ALL-POINTS TECHNOLOGY CORPORATION FOR ADDITIONAL INFORMATION. THE CONTRACTOR SHALL VERIFY ALL SITE CONDITIONS IN THE FIELD AND CONTACT THE PROJECT DEVELOPER IF THERE ARE ANY QUESTIONS OR CONFLICTS REGARDING THE CONSTRUCTION DOCUMENTS AND/OR FIELD CONDITIONS SO THAT APPROPRIATE REVISIONS CAN BE MADE PRIOR TO BIDDING/CONSTRUCTION. ANY CONFLICT BETWEEN THE DRAWINGS AND SPECIFICATIONS SHALL BE CONFIRMED WITH THE PROJECT DEVELOPERS CONSTRUCTION MANAGER PRIOR TO CONSTRUCTION.
- THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS OF ALL PRODUCTS, MATERIALS PER PLANS AND SPECIFICATIONS TO THE PROJECT DEVELOPER FOR REVIEW AND APPROVAL PRIOR TO FABRICATION OR DELIVERY TO THE SITE. ALLOW A MINIMUM OF 14 WORKING DAYS FOR REVIEW.
- SHOULD ANY UNKNOWN OR INCORRECTLY LOCATED EXISTING PIPING OR OTHER UTILITY BE UNCOVERED DURING EXCAVATION, CONSULT THE PROJECT DEVELOPER IMMEDIATELY FOR DIRECTIONS BEFORE PROCEEDING FURTHER WITH WORK IN THIS AREA.
- DO NOT INTERRUPT EXISTING UTILITIES SERVICING FACILITIES OCCUPIED AND USED BY THE PROJECT DEVELOPER OR OTHERS DURING OCCUPIED HOURS, EXCEPT WHEN SUCH INTERRUPTIONS HAVE BEEN AUTHORIZED IN WRITING BY THE PROJECT DEVELOPER AND THE LOCAL MUNICIPALITY. INTERRUPTIONS SHALL ONLY OCCUR AFTER ACCEPTABLE TEMPORARY SERVICE HAS BEEN PROVIDED.
- THE CONTRACT LIMIT IS THE PROPERTY LINE UNLESS OTHERWISE SPECIFIED OR SHOWN ON THE CONTRACT DRAWINGS.
- THE CONTRACTOR SHALL ABIDE BY ALL OSHA, FEDERAL, STATE AND LOCAL REGULATIONS WHEN OPERATING CRANES, BOOMS, HOISTS, ETC. IN CLOSE PROXIMITY TO OVERHEAD ELECTRIC LINES. IF CONTRACTOR MUST OPERATE EQUIPMENT CLOSE TO ELECTRIC LINES, CONTACT POWER COMPANY TO MAKE ARRANGEMENTS FOR PROPER SAFEGUARDS. ANY UTILITY COMPANY FEES SHALL BE PAID FOR BY THE CONTRACTOR.
- THE CONTRACTOR SHALL COMPLY WITH OSHA CFR 29 PART 1926 FOR EXCAVATION TRENCHING AND TRENCH PROTECTION REQUIREMENTS.
- THE ENGINEER IS NOT RESPONSIBLE FOR SITE SAFETY MEASURES TO BE EMPLOYED DURING CONSTRUCTION. THE ENGINEER HAS NO CONTRACTUAL DUTY TO CONTROL THE SAFEST METHODS OR MEANS OF THE WORK, JOB SITE RESPONSIBILITIES, SUPERVISION OF PERSONNEL OR TO SUPERVISE SAFETY AND DO NOT VOLUNTARILY ASSUME ANY SUCH DUTY OR RESPONSIBILITY.
- THE CONTRACTOR SHALL RESTORE ANY DRAINAGE STRUCTURE, PIPE, CONDUIT, PAVEMENT, CURBING, SIDEWALKS, LANDSCAPED AREAS OR SIGNAGE DISTURBED DURING CONSTRUCTION TO THEIR ORIGINAL CONDITION OR BETTER, AS APPROVED BY THE PROJECT DEVELOPER OR TOWN OF EAST HAMPTON.
- THE CONTRACTOR SHALL PROVIDE AS-BUILT RECORDS OF ALL CONSTRUCTION (INCLUDING UNDERGROUND UTILITIES) TO THE PROJECT DEVELOPER AT THE END OF CONSTRUCTION.
- ALTERNATIVE METHODS AND PRODUCTS, OTHER THAN THOSE SPECIFIED, MAY BE USED IF REVIEWED AND APPROVED BY THE PROJECT DEVELOPER, ENGINEER, AND APPROPRIATE REGULATORY AGENCY PRIOR TO INSTALLATION DURING THE BIDDING/CONSTRUCTION PROCESS.
- INFORMATION ON EXISTING UTILITIES AND STORM DRAINAGE SYSTEMS HAS BEEN COMPILED FROM AVAILABLE INFORMATION INCLUDING UTILITY PROVIDER AND MUNICIPAL RECORD MAPS AND/OR FIELD SURVEY AND IS NOT GUARANTEED CORRECT OR COMPLETE. UTILITIES AND STORM DRAINAGE SYSTEMS ARE SHOWN TO ALERT THE CONTRACTOR TO THEIR PRESENCE AND THE CONTRACTOR IS SOLELY RESPONSIBLE FOR DETERMINING ACTUAL LOCATIONS AND ELEVATIONS OF ALL UTILITIES AND STORM DRAINAGE SYSTEMS INCLUDING SERVICES. PRIOR TO DEMOLITION OR CONSTRUCTION, THE CONTRACTOR SHALL CONTACT "DIG SAFE" 72 HOURS BEFORE COMMENCEMENT OF WORK AT "811" AND VERIFY ALL UTILITY AND STORM DRAINAGE SYSTEM LOCATIONS.
- NO CONSTRUCTION OR DEMOLITION SHALL BEGIN UNTIL APPROVAL OF THE FINAL PLANS IS GRANTED BY ALL GOVERNING AND REGULATORY AGENCIES.

## SITE PLAN NOTES

- THE SURVEY WAS PROVIDED BY MARTIN SURVEYING ASSOCIATES. DATED JANUARY 15, 2020.
- THERE ARE BVWS LOCATED ON THE SITE AS INDICATED ON THE PLANS. BVW BOUNDARIES WERE FLAGGED AND LOCATED BY ALL POINTS TECHNOLOGY, INC. IN JANUARY 2020.
- THERE WILL BE MINIMAL GRADING ON SITE IN THE AREAS OF THE MINOR CLEARING, TO ENSURE THAT PROPER DRAINAGE IS MAINTAINED.
- THE CONTRACTOR SHALL FOLLOW THE RECOMMENDED SEQUENCE OF CONSTRUCTION NOTES PROVIDED ON THE EROSION CONTROL PLAN OR SUBMIT AN ALTERNATE PLAN FOR APPROVAL BY THE ENGINEER AND/OR PERMITTING AGENCIES PRIOR TO THE START CONSTRUCTION. ALLOW A MINIMUM OF 14 WORKING DAYS FOR REVIEW.
- PROPER CONSTRUCTION PROCEDURES SHALL BE FOLLOWED ON ALL IMPROVEMENTS WITHIN THIS PARCEL SO AS TO PREVENT THE SILTING OF ANY WATERCOURSE OR BVWS IN ACCORDANCE WITH FEDERAL, STATE, AND LOCAL REGULATIONS. IN ADDITION, THE CONTRACTOR SHALL ADHERE TO "EROSION CONTROL PLAN" CONTAINED HEREIN. THE CONTRACTOR SHALL BE RESPONSIBLE TO POST ALL BONDS AS REQUIRED BY GOVERNMENT AGENCIES WHICH WOULD GUARANTEE THE PROPER IMPLEMENTATION OF THE PLAN.
- ALL SITE WORK, MATERIALS OF CONSTRUCTION, AND CONSTRUCTION METHODS FOR EARTHWORK AND STORM DRAINAGE WORK, SHALL CONFORM TO THE SPECIFICATIONS AND DETAILS AND APPLICABLE SECTIONS OF THE PROJECT SPECIFICATIONS MANUAL. OTHERWISE THIS WORK SHALL CONFORM TO THE STATE OF CONNECTICUT DEPARTMENT OF TRANSPORTATION AND PROJECT GEOTECHNICAL REPORT IF THERE IS NO PROJECT SPECIFICATIONS MANUAL. ALL FILL MATERIAL UNDER STRUCTURES AND PAVED AREAS SHALL BE PER THE ABOVE STATED APPLICABLE SPECIFICATIONS, AND/OR PROJECT GEOTECHNICAL REPORT, AND SHALL BE PLACED IN ACCORDANCE WITH THE APPLICABLE SPECIFICATIONS UNDER THE SUPERVISION OF A QUALIFIED PROFESSIONAL ENGINEER. MATERIAL SHALL BE COMPACTED IN 8" LIFTS TO 95% OF THE MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D 1557 AT 95% PERCENT OF OPTIMUM MOISTURE CONTENT.
- ALL DISTURBANCE INCURRED TO PUBLIC, MUNICIPAL, COUNTY, STATE PROPERTY DUE TO CONSTRUCTION SHALL BE RESTORED TO ITS PREVIOUS CONDITION OR BETTER, TO THE SATISFACTION OF THE TOWN OF EAST HAMPTON AND STATE OF CONNECTICUT.
- IF IMPACTED OR CONTAMINATED SOIL IS ENCOUNTERED BY THE CONTRACTOR, THE CONTRACTOR SHALL SUSPEND EXCAVATION WORK OF IMPACTED SOIL AND NOTIFY THE PROJECT DEVELOPER AND/OR PROJECT DEVELOPER'S ENVIRONMENTAL CONSULTANT PRIOR TO PROCEEDING WITH FURTHER WORK IN THE IMPACTED SOIL LOCATION UNTIL FURTHER INSTRUCTED BY THE PROJECT DEVELOPER AND/OR PROJECT DEVELOPERS ENVIRONMENTAL CONSULTANT.

## UTILITY NOTES

- CONTRACTOR IS RESPONSIBLE FOR CONTACTING THE TOWN OF EAST HAMPTON TO SECURE CONSTRUCTION PERMITS AND FOR PAYMENT OF FEES FOR STREET CUTS AND CONNECTIONS TO EXISTING UTILITIES.
- REFER TO DRAWINGS BY PROJECT DEVELOPER FOR THE ONSITE ELECTRICAL DRAWINGS AND INTERCONNECTION TO EXISTING ELECTRICAL GRID. SITE CONTRACTOR SHALL SUPPLY AND INSTALL PIPE ADAPTERS AS NECESSARY AT BUILDING CONNECTION POINT OR AT EXISTING UTILITY OR PIPE CONNECTION POINT. THESE DETAILS ARE NOT INCLUDED IN THESE PLANS.
- UTILITY LOCATIONS AND PENETRATIONS ARE SHOWN FOR THE CONTRACTORS INFORMATION AND SHALL BE VERIFIED WITH THE ELECTRICAL ENGINEER AND THE PROJECT DEVELOPERS CONSTRUCTION MANAGER PRIOR TO THE START OF CONSTRUCTION.
- THE CONTRACTOR SHALL VISIT THE SITE AND VERIFY THE ELEVATION AND LOCATION OF ALL UTILITIES BY VARIOUS MEANS PRIOR TO BEGINNING ANY EXCAVATION. TEST PITS SHALL BE DUG AT ALL LOCATIONS WHERE PROP. SANITARY SEWERS AND WHERE PROP. STORM PIPING WILL CROSS EXISTING UTILITIES, AND THE HORIZONTAL AND VERTICAL LOCATIONS OF THE UTILITIES SHALL BE DETERMINED. THE CONTRACTOR SHALL CONTACT THE PROJECT DEVELOPER IN THE EVENT OF ANY DISCOVERED OR UNFORESEEN CONFLICTS BETWEEN EXISTING AND PROPOSED SANITARY SEWERS, STORM PIPING AND UTILITIES SO THAT AN APPROPRIATE MODIFICATION MAY BE MADE.
- UTILITY CONNECTION DESIGN AS REFLECTED ON THE PLAN MAY CHANGE SUBJECT TO UTILITY PROVIDER AND GOVERNING AUTHORITY STAFF REVIEW.
- THE CONTRACTOR SHALL ENSURE THAT ALL UTILITY PROVIDERS AND GOVERNING AUTHORITY STANDARDS FOR MATERIALS AND CONSTRUCTION METHODS ARE MET. THE CONTRACTOR SHALL PERFORM PROPER COORDINATION WITH THE RESPECTIVE UTILITY PROVIDER.
- THE CONTRACTOR SHALL ARRANGE FOR AND COORDINATE WITH THE RESPECTIVE UTILITY PROVIDERS FOR SERVICE INSTALLATIONS AND CONNECTIONS. THE CONTRACTOR SHALL COORDINATE WORK TO BE PERFORMED BY THE VARIOUS UTILITY PROVIDERS AND SHALL PAY ALL FEES FOR CONNECTIONS, DISCONNECTIONS, RELOCATIONS, INSPECTIONS, AND DEMOLITION UNLESS OTHERWISE STATED IN THE PROJECT SPECIFICATIONS MANUAL AND/OR GENERAL CONDITIONS OF THE CONTRACT.
- ALL EXISTING PAVEMENT WHERE UTILITY PIPING IS TO BE INSTALLED SHALL BE SAW CUT. AFTER UTILITY INSTALLATION IS COMPLETED, THE CONTRACTOR SHALL INSTALL TEMPORARY AND/OR PERMANENT PAVEMENT REPAIR AS DETAILED ON THE DRAWINGS OR AS REQUIRED BY THE TOWN OF EAST HAMPTON.
- ALL PIPES SHALL BE LAID ON STRAIGHT ALIGNMENTS AND EVEN GRADES USING A PIPE LASER OR OTHER ACCURATE METHOD.
- RELOCATION OF UTILITY PROVIDER FACILITIES, SUCH AS POLES, SHALL BE DONE IN ACCORDANCE WITH THE REQUIREMENTS OF THE UTILITY PROVIDER.
- THE CONTRACTOR SHALL COMPACT PIPE BACKFILL IN 8" LIFTS ACCORDING TO THE PIPE BEDDING DETAILS. TRENCH BOTTOM SHALL BE STABLE IN HIGH GROUNDWATER AREAS. A PIPE FOUNDATION SHALL BE USED PER THE TRENCH DETAILS AND IN AREAS OF ROCK EXCAVATION.
- CONTRACTOR TO PROVIDE STEEL SLEEVES AND ANNULAR SPACE SAND FILL FOR UTILITY PIPE AND CONDUIT CONNECTIONS UNDER FOOTINGS.
- ALL UTILITY CONSTRUCTION IS SUBJECT TO INSPECTION FOR APPROVAL PRIOR TO BACKFILLING, IN ACCORDANCE WITH THE APPROPRIATE UTILITY PROVIDER REQUIREMENTS.
- A ONE-FOOT MINIMUM VERTICAL CLEARANCE BETWEEN WATER, GAS, ELECTRICAL, AND TELEPHONE LINES AND STORM PIPING SHALL BE PROVIDED. A SIX-INCH MINIMUM CLEARANCE SHALL BE MAINTAINED BETWEEN STORM PIPING AND SANITARY SEWER. A 6-INCH TO 18-INCH VERTICAL CLEARANCE BETWEEN SANITARY SEWER PIPING AND STORM PIPING SHALL REQUIRE CONCRETE ENCASEMENT OF THE PROP. SANITARY PIPING.
- THE CONTRACTOR SHALL RESTORE ANY UTILITY STRUCTURE, PIPE, CONDUIT, PAVEMENT, CURBING, SIDEWALKS, DRAINAGE STRUCTURE, SWALE OR LANDSCAPED AREAS DISTURBED DURING CONSTRUCTION, TO THEIR ORIGINAL CONDITION OR BETTER TO THE SATISFACTION OF THE PROJECT DEVELOPER AND TOWN OF EAST HAMPTON.
- INFORMATION ON EXISTING UTILITIES AND STORM DRAINAGE HAS BEEN COMPILED FROM AVAILABLE INFORMATION INCLUDING UTILITY PROVIDER AND MUNICIPAL RECORD MAPS AND/OR FIELD SURVEY, AND IS NOT GUARANTEED CORRECT OR COMPLETE. UTILITIES AND STORM DRAINAGE ARE SHOWN TO ALERT THE CONTRACTOR TO THEIR PRESENCE. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR DETERMINING ACTUAL LOCATIONS AND ELEVATIONS OF ALL UTILITIES AND STORM DRAINAGE INCLUDING SERVICES. CONTACT "DIG SAFE" AT 811 72 HOURS PRIOR TO CONSTRUCTION AND VERIFY ALL UNDERGROUND AND OVERHEAD UTILITY AND STORM DRAINAGE LOCATIONS. THE CONTRACTOR SHALL EMPLOY THE USE OF A UTILITY LOCATING COMPANY TO PROVIDE SUBSURFACE UTILITY ENGINEERING CONSISTING OF DESIGNATING UTILITIES AND STORM PIPING ON PRIVATE PROPERTY WITHIN THE CONTRACT LIMIT AND CONSISTING OF DESIGNATING AND LOCATING WHERE PROP. UTILITIES AND STORM PIPING CROSS EXISTING UTILITIES AND STORM PIPING WITHIN THE CONTRACT LIMITS.
- THE CONTRACTOR SHALL ARRANGE AND COORDINATE WITH UTILITY PROVIDERS FOR WORK TO BE PERFORMED BY UTILITY PROVIDERS. THE CONTRACTOR SHALL PAY ALL UTILITY FEES UNLESS OTHERWISE STATED IN THE PROJECT SPECIFICATION MANUAL AND GENERAL CONDITIONS, AND REPAIR PAVEMENTS AS NECESSARY.
- ELECTRIC DRAWINGS AND REQUIREMENTS ARE NOT INCLUDED AS PART OF THIS DRAWING SET AND SHOULD BE OBTAINED FROM THE PROJECT DEVELOPER.
- ALTERNATIVE METHODS AND PRODUCTS OTHER THAN THOSE SPECIFIED MAY BE USED IF REVIEWED AND APPROVED BY THE PROJECT DEVELOPER, ENGINEER, AND APPROPRIATE REGULATORY AGENCIES PRIOR TO INSTALLATION.
- THE CONTRACTOR SHALL MAINTAIN ALL FLOWS AND UTILITY CONNECTIONS TO EXISTING BUILDINGS WITHOUT INTERRUPTION UNLESS UNTIL AUTHORIZED TO DISCONNECT BY THE PROJECT DEVELOPER, TOWN OF EAST HAMPTON, UTILITY PROVIDERS AND GOVERNING AUTHORITIES.



55 GREENS FARMS ROAD  
WESTPORT, CT 06880  
OFFICE: (203)-557-5554



3 SADDLEBROOK DRIVE PHONE: (860)-663-1607  
KILLINGWORTH, CT 06419 FAX: (860)-663-0935  
WWW.ALLPOINTSTECH.COM

### CSC PERMIT SET

NO	DATE	REVISION
0	02/14/20	FOR REVIEW: BJP
1	02/24/20	CSC SUBMISSION: BJP
2		
3		
4		
5		
6		

### DESIGN PROFESSIONAL OF RECORD

PROF: BRADLEY J. PARSONS P.E.  
COMP: ALL-POINTS TECHNOLOGY CORPORATION  
ADD: 3 SADDLEBROOK DRIVE  
KILLINGWORTH, CT 06419

OWNER: SKINNER STREET PROPERTIES LLC  
ADDRESS: 9 SEQUOIA TRAIL  
EAST HAMPTON, CT 06424

### CP EAST HAMPTON SOLAR I & CP EAST HAMPTON SOLAR II

SITE: 46 SKINNER STREET  
ADDRESS: EAST HAMPTON, CT 06424

APT FILING NUMBER: CT567110

DATE: 02/14/20  
DRAWN BY: CSH  
CHECKED BY: BJP

SHEET TITLE:  
**SITE NOTES**

SHEET NUMBER:

**DN-3**

